

Macarthur Wind Farm

Noise Compliance Assessment - Round 2



Macarthur Wind Farm

Noise Compliance Assessment - Round 2

Client: Vestas Australian Wind Technology Pty Ltd

ABN: 800896553878

Prepared by

AECOM Australia Pty Ltd

Level 9, 8 Exhibition Street, Melbourne VIC 3000, Australia
T +61 3 9653 1234 F +61 3 9654 7117 www.aecom.com
ABN 20 093 846 925

08-Apr-2014

Job No.: 60279731

AECOM in Australia and New Zealand is certified to the latest version of ISO9001, ISO14001, AS/NZS4801 and OHSAS18001.

© AECOM Australia Pty Ltd (AECOM). All rights reserved.

AECOM has prepared this document for the sole use of the Client and for a specific purpose, each as expressly stated in the document. No other party should rely on this document without the prior written consent of AECOM. AECOM undertakes no duty, nor accepts any responsibility, to any third party who may rely upon or use this document. This document has been prepared based on the Client's description of its requirements and AECOM's experience, having regard to assumptions that AECOM can reasonably be expected to make in accordance with sound professional principles. AECOM may also have relied upon information provided by the Client and other third parties to prepare this document, some of which may not have been verified. Subject to the above conditions, this document may be transmitted, reproduced or disseminated only in its entirety.

Quality Information

Document Macarthur Wind Farm
 Ref 60279731
 Date 08-Apr-2014
 Prepared by Andrew Mitchell
 Reviewed by David Peoples

Revision History



Revision	Revision Date	Details	Authorised	
			Name/Position	Signature
0	14-Mar-2014	Draft	Andrew Mitchell Principal Acoustics Engineer	
1	08-Apr-2014	For issue	Andrew Mitchell Principal Acoustics Engineer	

Table of Contents

Executive Summary	i
1.0 Introduction	1
2.0 Wind Farm Description	1
3.0 Noise Criteria	2
3.1 Planning Permit Requirements	2
3.2 Specific Criteria at Permit Reference Locations	3
4.0 Noise Measurement Methodology	4
4.1 Procedure	4
4.2 Noise Logger Positions at the Reference Locations	4
4.3 Number of Data Points	7
4.4 Instrumentation	7
5.0 Meteorological Data	8
6.0 Wind Farm Operation Data	10
7.0 Analysis of Measurement Results	10
7.1 Analysis Methodology	10
7.1.1 General Procedure	10
7.1.2 Data Exclusion	10
7.1.3 Curve Fitting	11
7.2 Measured Noise Levels	11
7.2.1 P22A	13
7.2.2 V16A	16
7.3 Discussion of Results	18
8.0 Assessment of Special Audible Characteristics	19
8.1 Introduction	19
8.2 Special Audible Characteristics	19
8.3 Assessment Procedure	19
8.4 Summary of Findings	20
9.0 Conclusion	21
Appendix A	
Glossary of Terms	A
Appendix B	
Site Layout	B
Appendix C	
Wind Turbine Details	C
Appendix D	
Planning Permit Noise Conditions	D
Appendix E	
Noise Monitoring Positions	E
Appendix F	
Calibration Certificates	F
Appendix G	
Method for Determining Wake-Free Wind Data	G
Appendix H	
Summary of Data Points Used for Analysis	H

Executive Summary

AECOM Australia Pty Ltd (AECOM) was commissioned by Vestas Australian Wind Technology Pty Ltd (Vestas), acting on behalf of AGL Energy Limited (AGL), to perform a noise compliance assessment in relation to noise emissions from Macarthur Wind Farm. The objective of the noise compliance assessment was to measure and assess the noise levels from the Wind Farm in relation to the requirements of the Macarthur Wind Farm Planning Permit (PL-SP/05/0283) amended on 7 April 2011.

The Planning Permit requires compliance with the operational noise conditions for the Wind Farm to be demonstrated through two rounds of noise monitoring – the first within two months of commencement of operation of the Wind Farm, and the second between 10 and 12 months after the commencement of the first round of noise monitoring.

In accordance with the Planning Permit, a first round of noise compliance monitoring was completed between 8 February and 27 March 2013, immediately after the Wind Farm began full operation. The methodology and results of the first round of noise compliance monitoring are documented in AECOM Report 60279731_Noise Compliance Rpt_R0, dated 26 April 2013. The results showed that the Wind Farm was complying with the noise conditions prescribed by the Planning Permit.

This present report documents the methodology and results of the second round of noise compliance monitoring, which was conducted between 29 January and 26 February 2014.

The Planning Permit requires that noise compliance monitoring be undertaken at the six reference dwellings (reference locations) originally used to measure the background sound levels prior to the Planning Permit Application.

Four of these locations were not included in the second round of noise compliance monitoring; T20A, where the dwelling was removed during construction of the Wind Farm and the land is now understood to be subject to a restrictive covenant preventing any dwelling being developed or constructed in future, and Q15A, T25A, and X21A, where the landowners did not provide approval for the second round of noise monitoring to be conducted.

The monitoring was therefore conducted at the remaining two reference locations, P22A and V16A. Note however, the dwelling at V16A has been decommissioned and is understood to be subject to a restrictive covenant preventing any dwelling being developed or constructed on this land in the future. The noise levels at V16A have therefore been measured and presented for information only, as V16A is not subject to the Wind Farm's noise compliance obligations.

In accordance with the Planning Permit, the noise levels at each applicable reference location must comply with a noise limit of the greater of 40 dB(A), or 5 dB(A) above the background noise level, when assessed in accordance with NZS 6808:1998 *Acoustics – The Assessment and Measurement of Sound from Wind Turbine Generators*.

Environmental noise loggers were installed at the reference locations and configured in accordance with the requirements of NZS 6808:1998 and the Macarthur Wind Farm Planning Permit.

The measured noise level data was correlated with wind speed data that was collected at the Wind Farm, and provided to AECOM.

In accordance with the methodology prescribed by NZS 6808:1998, regression analysis was used to determine the noise level at each reference location for each wind speed, based on the $L_{95(10 \text{ min})}$ noise level vs wind speed data pairs measured for each 10-minute interval during the noise monitoring period.

At each measurement location, the Wind Farm noise levels at each integer wind speed were measured to comply with the applicable noise criteria.

Pursuant to NZS 6808:1998, subjective assessments of the Wind Farm noise were also undertaken at each reference location during the monitoring period, in order to determine if the noise from the Wind Farm exhibits any special audible characteristics (SACs) that may require a penalty adjustment to be applied.

Special audible characteristics have not been determined to be present at any of the reference locations. Therefore, it is determined that no penalty adjustment for special audible characteristics is applicable.

Based on the noise monitoring and assessments that have been conducted, as outlined in this report and the previous noise compliance monitoring report, the noise emissions from Macarthur Wind Farm comply with the acoustic requirements of the Macarthur Wind Farm Planning Permit.

1.0 Introduction

AECOM Australia Pty Ltd (AECOM) was commissioned by Vestas Australian Wind Technology Pty Ltd (Vestas), acting on behalf of AGL Energy Limited (AGL), to perform a noise compliance assessment of the noise emissions from Macarthur Wind Farm. The objective of the noise compliance assessment was to measure and assess the noise levels from the Wind Farm in relation to the requirements of the Macarthur Wind Farm Planning Permit (PL-SP/05/0283) amended on 7 April 2011.

The Planning Permit requires compliance with the operational noise conditions for the Wind Farm to be demonstrated through two rounds of noise monitoring – the first within two months of commencement of operation of the Wind Farm, and the second between 10 and 12 months after the commencement of the first round of noise monitoring.

In accordance with the Planning Permit, a first round of noise compliance monitoring was completed between 8 February and 27 March 2013, immediately after the Wind Farm began full operation. The methodology and results of the first round of noise compliance monitoring are documented in AECOM Report 60279731_Noise Compliance Rpt_R0, dated 26 April 2013. The results showed that the Wind Farm was complying with the noise conditions prescribed by the Planning Permit.

This report documents the methodology and results of the second round noise compliance assessment, which has been performed based on noise measurements between 29 January and 26 February 2014.

A glossary of the acoustic terms used in this report is presented in Appendix A.

2.0 Wind Farm Description

Macarthur Wind Farm is located approximately 16km east of Macarthur township, between Hamilton and Warrnambool in south-western Victoria. Figure 1 shows the site location.



Figure 1 Macarthur Wind Farm Location (Source: Google Earth Pro)

The Wind Farm consists of 140 Vestas V112 3MW wind turbines spread over an area of approximately 5500 hectares.

The land on which the Wind Farm is situated is used predominantly for grazing of livestock, and the terrain is generally flat open grassland, with minor undulations.

There are approximately 30 residential dwellings within the predicted 35 dB L_{A95} noise contour of the Wind Farm, including residences owned by the landowners who host wind turbines on their property (host landowners).

The Wind Farm layout is shown in Appendix B and details of the wind turbines are presented in Appendix C.

3.0 Noise Criteria

3.1 Planning Permit Requirements

Conditions 16 to 33 of the Macarthur Wind Farm Planning Permit set out the noise-related requirements for the operation of the Wind Farm. A copy of the relevant section of the Planning Permit is presented in Appendix D.

Condition 16 of the Planning Permit states that:

“The operation of the wind energy facility must comply with the New Zealand Standard ‘Acoustics – The Assessment and Measurement of Sound from Wind Turbine Generators’ (NZS 6808:1998) (the ‘Standard’), at any dwelling existing in the vicinity of the wind energy facility as at 7 February 2006. In determining compliance with the Standard, the following shall apply:

- a) *The sound level from the operating wind energy facility, measured outdoors within 10 metres of a dwelling at any relevant nominated wind speed, shall not exceed the background level (L₉₅) by more than 5 dBA or a level of 40 dBA L₉₅, whichever is the greater. This ‘background sound level’ shall be determined by the method specified in NZS 6806:1998 [sic]. Compliance shall be determined separately for all time data and for night time data. Night time is defined as 10pm to 7am.*
- b) *If [the]sound has a special audible characteristic the measured sound level of the source shall have a 5 dB penalty applied. The EMP must provide detail on how special audible characteristics are to be determined and the penalty is to be applied.”*

Condition 22 of the Planning Permit requires that compliance noise monitoring be carried out at the six reference dwellings (reference locations) where background sound levels were originally measured prior to the Planning Permit Application, subject to the approval of their owners. These reference locations are listed in Table 1, below, and are marked on the site map presented in Appendix B.

Table 1 Planning Permit Noise Monitoring Reference Locations

Location ID	Address
P22A	221 Eastwoods Road, Macarthur, VIC 3286
Q15A	457 Eckersleys Road, Gerrigerrup, VIC 3289
T20A	1743 Macarthur Hawkesdale Road, Macarthur, VIC 3286
T25A	842 Kangertong Road, Hawkesdale, VIC 3287
V16A	926 Gerrigerrup Minhamite Road, Gerrigerrup, VIC 3289
X21A	2123 Greens Lane, Hawkesdale, VIC 3287

In relation to the above reference locations the following should be noted:

- 1) Whilst operational noise levels have been measured at V16A, the dwelling has been decommissioned and the land is understood to be subject to a restrictive covenant preventing the development or construction of any dwelling in the future. The change in status of this particular land has been brought about through changed ownership from McKenry to Robertson (wind farm host landowner) since the Planning Permit was issued. Notwithstanding this, noise measurements have been conducted at this reference location and the results included for information only.
- 2) The dwelling at T20A no longer exists and the land is understood to be subject to a restrictive covenant preventing development or construction of any dwelling in the future. The change in status of this particular

land has been brought about through changed ownership from Sharp to Officer (wind farm host landowner) since the Planning Permit was issued.

- 3) In accordance with the Planning Permit, the owners of Q15A, T25A and X21A were formally requested by AGL to provide access to their property for noise monitoring. The owners rejected the request. As Condition 22 of the Planning Permit states that the noise compliance monitoring is subject to approval of the property owners, locations Q15A, T25A and X21A have not been considered further in this noise compliance assessment.

3.2 Specific Criteria at Permit Reference Locations

Background noise levels for the purpose of determining specific noise criteria for each reference location were originally measured at the Planning Permit reference locations by Hayes McKenzie¹ in December 2004, prior to granting of the Planning Permit. Although noise criteria for the reference locations were established by Hayes McKenzie based on their measurements, the Planning Panel Report (May 2006) identified two shortcomings with the original noise data gathered by Hayes McKenzie.

- Firstly, the Panel deemed that the data gathered at T20A was unreliable; and
- Secondly, the Panel noted that the original background noise levels determined by Hayes McKenzie had been correlated with wind speeds measured by a single meteorological mast, at a height of 80m above ground level. This differs from the actual hub height of the wind turbines (84m), and it was furthermore considered that wind speed measurements from a single met mast may not adequately represent the wind speeds across the whole site, given the size of the site.

The Panel therefore recommended that additional monitoring be conducted at T20A, and that a correlation be performed to relate the wind speeds measured during the Hayes McKenzie monitoring to the locations and heights of the anemometers of the six permanent meteorological masts that would be used for post-construction noise testing.

As a result of the above findings, and a decision by the Wind Farm developer to establish noise criteria for locations in addition to the reference locations, a comprehensive set of background noise measurements were performed to update the background noise data and noise criteria, and address the issues identified with the original measurements. The updated background noise measurements were performed by AECOM during the period from August 2010 to January 2011, in the months prior to commencement of construction of the Wind Farm.

Details in relation to the measurement and determination of the updated background noise levels have been presented previously in a separate AECOM report 'Macarthur Wind Farm Background Noise Monitoring', Report No. A11C01RP-03, revision 3, dated 26 April 2013.

It is noted that the updated background noise levels and criteria differ slightly from those determined by Hayes McKenzie. These differences are attributable to the following factors:

- 1) The updated background noise data has been correlated with the wind data from the permanent meteorological masts at the Wind Farm, which differ in position and height to the mast used by Hayes McKenzie.
- 2) The updated background noise data reflects changes in the background noise level due to vegetation growth, clearing of vegetation, and /or other changes to the properties and surrounding areas which occurred in the five to six year period which elapsed between the original background noise measurements and the updated background noise measurements.
- 3) The noise logger positions at each property were revised for the updated background noise measurements, to better represent the background noise levels at the dwellings and avoid potential sources of extraneous noise.

The updated background noise levels have been used to develop the noise criteria for this assessment. This information is presented in Section 7.2 with the noise compliance measurements.

¹ *Macarthur Wind Farm – Noise Impact Assessment*, Report No. 03.545-01 Final, prepared for Macarthur Wind Farm Pty Ltd. by Hayes McKenzie APW, May 2005

4.0 Noise Measurement Methodology

4.1 Procedure

Environmental noise loggers were installed at the reference locations and configured in accordance with the requirements of NZS 6808:1998 and the Macarthur Wind Farm Planning Permit. In particular:

- Each noise logger was configured to measure 'A'-weighted, 'F' time-weighted $L_{95,10\text{min}}$ sound pressure levels;
- The microphone of each noise logger was set at a height between 1.2m and 1.5m above ground level, and a nominally 90mm diameter foam windscreen was placed over the microphone to reduce extraneous wind noise effects;
- The same noise logger position as previously used for the updated background noise monitoring was used for the noise compliance monitoring. Where practicable, the logger was located at least 5m from any significant vegetation and sound-reflecting structures, and within 10m of the dwelling, on the side of the dwelling that would be most exposed to noise from the Wind Farm. However, for some of the reference locations, it was not practical to locate the logger within 10m of the dwelling. Where the logger position deviates from the ideal position given above, the deviation is noted in Section 4.2 along with the reasons for the deviation.
- Noise monitoring was conducted over a concurrent period of nominally 4 weeks to provide a substantial data set on which to base the analysis. In accordance with Section 5.2.3 of NZS 6808:1998, a minimum of 1440 data points overall, equivalent to 10 days of continuous monitoring at 10 minute intervals, is recommended.
- Each noise logger was visited on a weekly basis during the noise monitoring period to check that it was operating correctly and to perform a field calibration check. At the times of all checks, the noise loggers were found to be operating correctly.

4.2 Noise Logger Positions at the Reference Locations

Details of the position where noise monitoring was conducted at each reference location are presented in Table 2. The site map in Appendix B shows the position of each reference location relative to the Wind Farm. Aerial photographs showing the position of the noise logger at each reference location are presented in Appendix E, along with photographs showing the installed noise logger.

Table 2 Noise Logger Positions at Reference Locations

Location ID	Address	Coordinates of Logger* (UTM WGS84 Zone 54H)		Approx Distance to Dwelling	Approx Distance to Nearest Turbine	Notes
		Easting	Northing			
P22A	221 Eastwoods Road, Macarthur, VIC 3286	599499	5786224	8m	1.5km	<ul style="list-style-type: none"> – The noise logger was installed at the same logger position as used for the updated background noise monitoring in September and October 2010, and the first round of operational noise compliance monitoring in February and March 2013. – In the first round of operational noise compliance monitoring it was noted that there had been growth of plants adjacent to the logger position since the updated background noise measurements were performed, and that wind induced noise from the additional vegetation may have resulted in higher background noise levels compared with when the updated background noise measurements were performed. For the second round of operational noise compliance monitoring, the resident had cut down some of the plants adjacent to the logger position, reducing the amount of vegetation in the immediate area of the logger. However, the garden plot to the north of the logger position still had significantly more growth compared with the period when the updated background noise monitoring was performed. – It was also noted during our visits to the site that wind-induced noise from a row of trees approximately 40m to the east of the logger position typically dominated the noise environment at the logger position during periods of moderate to strong wind.

Location ID	Address	Coordinates of Logger* (UTM WGS84 Zone 54H)		Approx Distance to Dwelling	Approx Distance to Nearest Turbine	Notes
		Easting	Northing			
V16A	926 Gerrigerrup Minhamite Road, Gerrigerrup, VIC 3289	605805	5792902	24m	700m	<ul style="list-style-type: none"> – The noise logger was installed at the same location as used for the original background noise monitoring conducted by Hayes Mackenzie in 2004. Updated background noise monitoring was not conducted at this reference location because it is subject to an agreement with the host landowner in accordance Condition 17 of the Planning Permit, this location, which restricts this reference location from being used as a dwelling. The noise criteria are therefore not applicable at this location. – This position was approximately 24m from the dwelling, and meant that the logger was located away from trees that are near to the dwelling. It was however noted on our visits to site during the monitoring period that noise from the trees still dominated the noise environment at the measurement location during periods of moderate and strong wind. – The Wind Farm noise levels at the measurement location were considered to be representative of those within 10m of the dwelling. – At the time of the monitoring, livestock were grazing in the paddocks around this dwelling. A pen was constructed around the noise monitor to keep livestock from interfering with the equipment. – On each occasion when this site was visited during the compliance monitoring period it was found that either sheep or cows were in the area of the logger. It is likely that noise from the sheep would have had some influence the noise measurements performed at this location, particularly during periods of lower wind speed. – Noise from an old wind mill at the rear of the property was also audible.

* Coordinates from hand-held GPS receiver, typical accuracy +/- 3m. The noise logger positions were confirmed visually to be the same as the logger positions used for the background noise monitoring and the first round of operational noise compliance monitoring, using photographs from the previous noise monitoring reports.

4.3 Number of Data Points

Section 5.2.3 of NZS 6808:1998 recommends that noise compliance monitoring should be based on a minimum of 1440 measured data points ($L_{A95(10min)}$ vs wind speed), equivalent to 10 days of continuous monitoring in 10 minute intervals. The standard does not separately specify a minimum number of night-time data points required, but the recommendation of 1440 overall data points implies that a minimum of 540 night-time data points would be required, noting that 10 nights from 10pm to 7am equates to 540 10-minute data points.

Table 3 below notes the number of data points used in the noise compliance assessment for each reference location after exclusion of periods of rain, any significant periods where extraneous noise influence was obvious and periods where the wind farm operation was not representative of normal operation. The number of data points used in the assessment at each reference location was more than the 1440 all-time and 540 night-time points required to comply with the recommendations of NZS 6808:1998.

Table 3 Number of Data Points Used in Analysis

Location ID	Monitoring Period		All-time Data (24 hours)	Night-time Data (10pm to 7am)
	Start	End		
P22A	29 January 2014	26 February 2014	2462	981
V16A	29 January 2014	26 February 2014	3227	1261

A more detailed breakdown of the data points captured during the monitoring period for each reference location is presented in Appendix H.

4.4 Instrumentation

In accordance with Condition 23 of the Planning Permit, all acoustic instrumentation had been calibrated by a NATA² accredited laboratory, and held current certificates of calibration at the time of the monitoring. Details of the acoustic instruments used at each reference location are presented in Table 4. The calibration certificates for each instrument are presented in Appendix F.

The readings of the noise loggers were field-checked using a portable sound level calibrator at the beginning and end of the noise monitoring period, and each week during the monitoring period. At the time of all calibration checks the noise loggers were found to be reading the correct level.

Table 4 Instrumentation Details

Location ID	Instrument Description	Serial No.	Date of Last Laboratory Calibration*
P22A	Rion NL-21 Class 2 Environmental Noise Logger	865768	20 September 2012
V16A	Rion NL-21 Class 2 Environmental Noise Logger	187447	26 April 2012
-	Bruel and Kjaer 2250 Sound Level Meter	2600404	30 May 2012
-	Rion NC-74 Portable Sound Level Calibrator	35084189	16 May 2013

* In accordance with NATA guidelines and AS1055.1:1997³, laboratory calibration of Sound Level Meters is valid for two years, and laboratory calibration of Sound Level Calibrators is valid for one year.

² National Association of Testing Authorities

³ Australian Standard 1055.1:1997 'Acoustics – Description and measurement of environmental noise'

5.0 Meteorological Data

Meteorological data for the purpose of the noise compliance assessment was obtained from the permanent meteorological masts (met masts) located at the Wind Farm.

There are six permanent met masts at the Wind Farm, which are located at the positions given in Table 5, below. The positions of the met masts are also marked on the site map presented in Appendix B.

Table 5 Meteorological Mast Locations

Meteorological Mast ID	GPS Coordinates of Logger (UTM WGS84 Zone 54H)	
	Easting	Northing
M1	603659	5794791
M2	601520	5792228
M3	600644	5785321
M4	605928	5784988
M5	604870	5788838
M6	599468	5787226

The nature of the Wind Farm layout means that all the met masts are located at positions where they may be affected by the wake of the wind turbines for certain wind directions. The wind speed data used for the noise analysis was derived from a combination of the six met masts to ensure that all data used was not wake affected, as per the requirement of Section 4.5.4 of NZS 6808:1998.

The procedure used to determine wake free wind speed data for the noise compliance assessment was provided by the project's wind analyst, Garrad Hassan. A summary of this procedure is presented in Appendix G.

Each of the met masts comprises a range of sensors to measure wind speed, wind direction, temperature, humidity, and rainfall. The sensors are located on the masts as shown in Figure 2.

For the purpose of the noise compliance assessment, wind directions were determined from the wind vanes at approximately 82m above ground level (AGL), and the wind speeds at the each met mast were taken from one of the two cup anemometers located at 84m AGL (wind turbine hub-height). The particular anemometer that was used from each met mast at any given point in time was dependent on the wind direction at the time, so that the anemometer used was not within the wake of the met mast tower. Details of the anemometer selection method are presented in Appendix G.

All wind speed and direction data used for the noise compliance assessment was in terms of 10-minute averages. The measurement time intervals of the noise monitoring equipment were synchronised with the measurement intervals of the met masts.

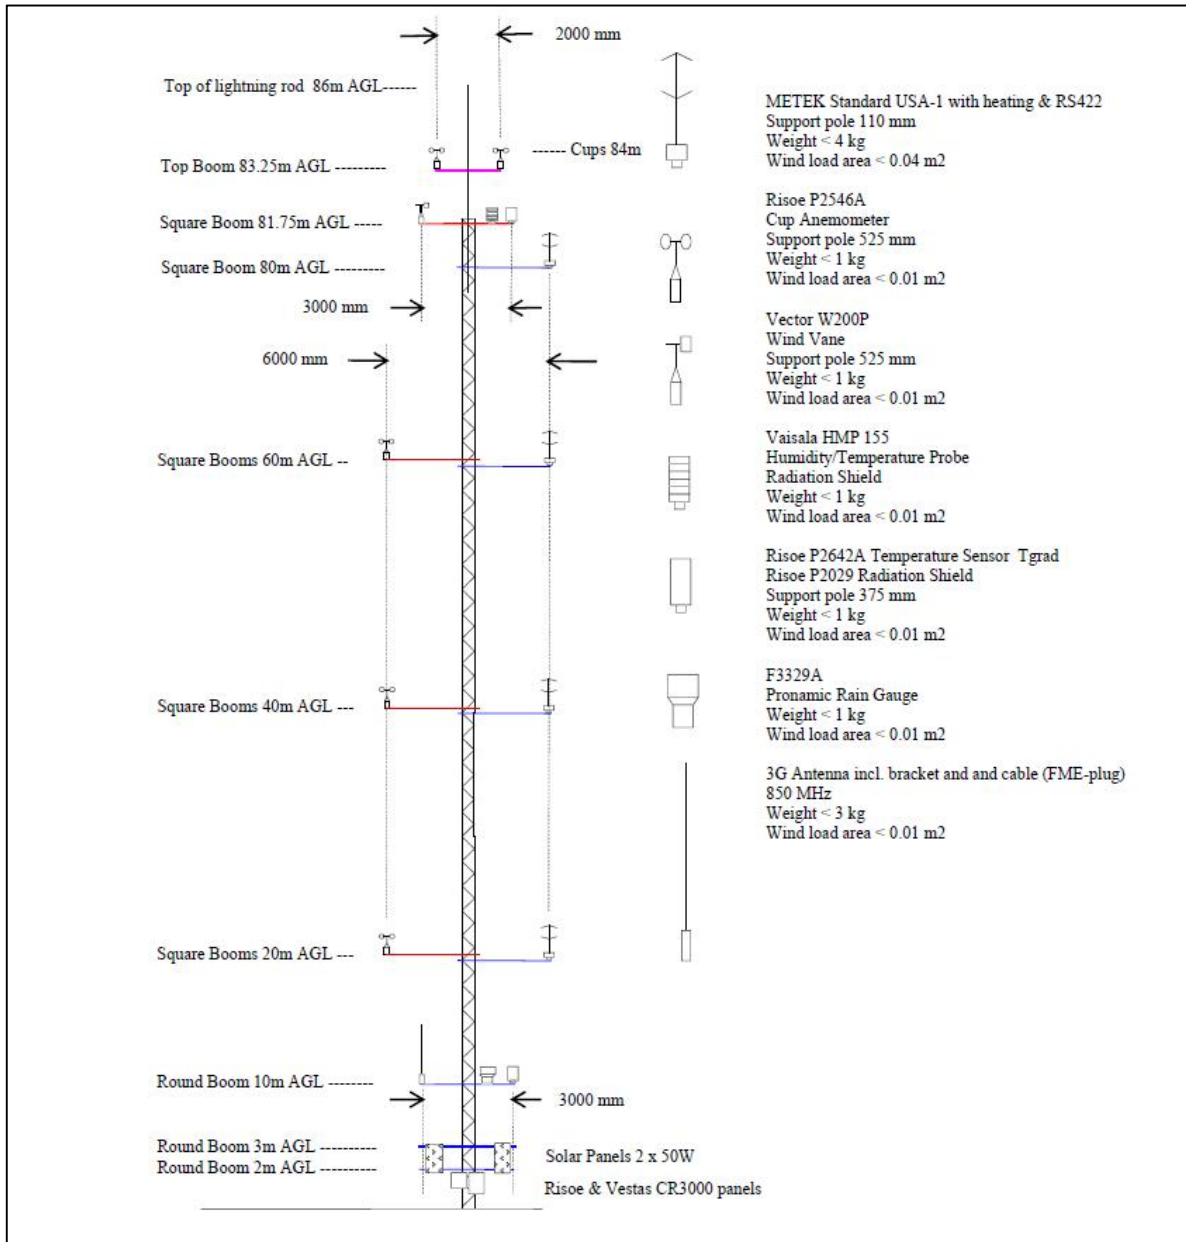


Figure 2 Meteorological Mast Sensors (Source: Vestas Macarthur Wind Farm Met Mast Installation Report, October 2012)

6.0 Wind Farm Operation Data

Wind farm operation data for the period of the monitoring was provided to AECOM by Vestas in the form of run-time logs indicating the number of seconds during each 10 minute period that each wind turbine at the Wind Farm was available to generate power.

This information was used to determine if the Wind Farm was operating normally, or if unrepresentative noise data needed to be excluded from the analysis, due to wind turbines in the vicinity of the reference locations not being available to operate (for example due to a fault or service shutdown).

AECOM understand that normal wind farm operations will typically involve some wind turbines being out of service, for one or more of the following reasons:

- Routine planned maintenance of the wind turbines;
- Routine planned maintenance of the electrical connection infrastructure (e.g. substation);
- Unplanned maintenance of the wind turbines in response to alarms or faults;
- Unplanned maintenance of the electrical connection infrastructure in response to alarms or faults;
- Constraints placed on energy exported to the electricity grid imposed by AEMO⁴ as part of its obligation to retain security of supply of electricity across the state.

The exclusion of data that would therefore not be considered representative noise data for use in the noise compliance assessment at each reference location is discussed in Section 7.1.2.

7.0 Analysis of Measurement Results

7.1 Analysis Methodology

7.1.1 General Procedure

As required by the Macarthur Wind Farm Planning Permit, the measured noise levels with the turbines operating were analysed separately for all-time and night time (10pm to 7am) periods.

In accordance with the methodology prescribed by NZS 6808:1998, regression analysis was used to determine the noise level at each reference location for each wind speed based on the $L_{95(10 \text{ min})}$ noise level vs wind speed data pairs measured for each 10-minute interval during the noise monitoring period.

7.1.2 Data Exclusion

When one or more turbines making a significant contribution to the Wind Farm noise levels at the reference location were not operating, data for the corresponding period was not included in the assessment. The procedure used to determine these periods is explained below:

- The predicted noise contribution from each wind turbine at each reference location was extracted from the SoundPLAN noise model of the Wind Farm that was used to predict the noise emissions of the Wind Farm during the design phase.
- The predicted noise contributions from each of the wind turbines that were operational during each 10-minute interval were then summed together and compared to the predicted total noise level at the reference location under consideration.
- Where the difference between the predicted noise level with all wind turbines operating and the predicted noise level with only the actual operating turbines was equal to or greater than 0.5 dB(A), the data for that 10-minute period was excluded from the analysis.

Data periods where rain occurred were also excluded from the analysis due to the potential influence of extraneous noise from rain on the measurements.

Finally, the remaining data was screened for periods where extraneous noise had clearly influenced the noise measurement data. Wind turbines typically provide a constant noise source, with noise emissions increasing with

⁴ The Australian Energy Market Operator

increasing wind speed. Noise data that is affected by extraneous noise (such as from tractors and other farm machinery) is removed through the identification of obvious outliers and periods where there is poor correlation between the noise levels and the wind speed data. For example, large spikes in noise level during the day, during periods of constant wind conditions, would be typical of farm machinery operating in the area of the logger.

Exclusion of data due to extraneous noise was however kept to a minimum, so that the assessment remained conservative (i.e. would not erroneously skew the determined noise levels downwards in the event that extraneous noise was incorrectly identified).

A summary of the number of data points used for the analysis at each reference location, and the number of data points excluded, is presented in Appendix H.

7.1.3 Curve Fitting

Following the data exclusion process as outlined above, polynomial regression curves of up to third order were fitted to the data and the correlations between the regression curve and the wind speed versus noise level data were calculated by a least-squares regression formula. For determination of the average measured noise levels, the curve that was used was one with the highest coefficient of determination that provided a reasonable fit to the data.

The measured noise levels represent the combination of background noise and wind farm noise. As such, the measured noise levels would be higher than the noise levels due to the Wind Farm only.

Although NZS 6808:1998 allows for the measured noise levels to be adjusted to compensate for the influence of background noise when assessing the noise levels from the Wind Farm, such an adjustment has not been applied to the measured levels presented in this report. The approach of comparing the combined background noise and wind farm noise to the assessment criteria (as used in this report), is therefore conservative.

7.2 Measured Noise Levels

The graphs on the following pages compare the measured ‘all-time’ and ‘night-time’ noise levels with the noise criteria determined for each reference location. Each graph shows each 10-minute data point measured with the wind turbines operating during the monitoring period as black dots. These black dots represent the overall noise levels due to wind farm noise and background noise combined. Above a wind speed of 10 m/s noise due to the wind farm does not increase with wind speed (see Note 1 below), despite the fact that the graphs show measured increases in noise level with wind speed.

The increase in noise level depicted by the graphs at wind speeds of greater than 10 m/s is attributable to the influence of increasing background noise with increasing wind speed. Therefore, the measured noise data in the region of the graph above 10 m/s, although still a combination of wind turbine noise and background noise, is primarily controlled by background noise. The noise level data points in this region of the graphs are shown as green dots on the graphs.

The polynomial fit-line to the measured noise data (i.e. the “average” noise level determined in accordance with NZS 6808:1998) is shown on the graph as an orange line. The orange line transitions to a green line above 10m/s, reflecting the fact that the noise levels above 10 m/s are controlled by background noise.

The updated background noise levels that were measured prior to construction of the Wind Farm are shown as light blue dots, behind the operational noise data, for information.

Tabulated noise levels and criteria for each integer wind speed are presented following the graphs for each of the monitored reference locations. Also shown for information are the noise levels measured during the first round of noise compliance monitoring in February and March 2013. The previously measured noise levels are shown in brackets below the noise levels that were measured during January and February 2014.

Note:

- 1) The normal mode of operation for the wind turbines at Macarthur Wind Farm is Noise Mode 0. This full power mode of operation was in effect throughout the compliance noise monitoring period. Based on data from Vestas’ General Specification for the turbines, the maximum wind turbine sound power levels in this operating mode occur at a wind speed of 10 m/s.
- 2) Based on data from Vestas’ General Specification for the turbines, the wind turbine cut-in wind speed is 3 m/s. Data at wind speeds less than the cut-in wind speed is shown greyed-out in the following figures.

- 3) Background noise levels are not presented on the charts for V16A, as updated background noise levels were not measured at V16A, and the raw data from the original background noise levels measured by Hayes Mackenzie in 2004 was not available to AECOM to plot on the chart.

Whilst operational noise levels have been measured at V16A, the dwelling has been decommissioned and the land is understood to be subject to a restrictive covenant preventing the development or construction of any dwelling in the future. The change in status of this particular land has been brought about through changed ownership from McKerry to Robertson (wind farm host landowner) since the Planning Permit was issued. Notwithstanding this, noise measurements have been conducted at this reference location and the results included for information only.

7.2.1 P22A

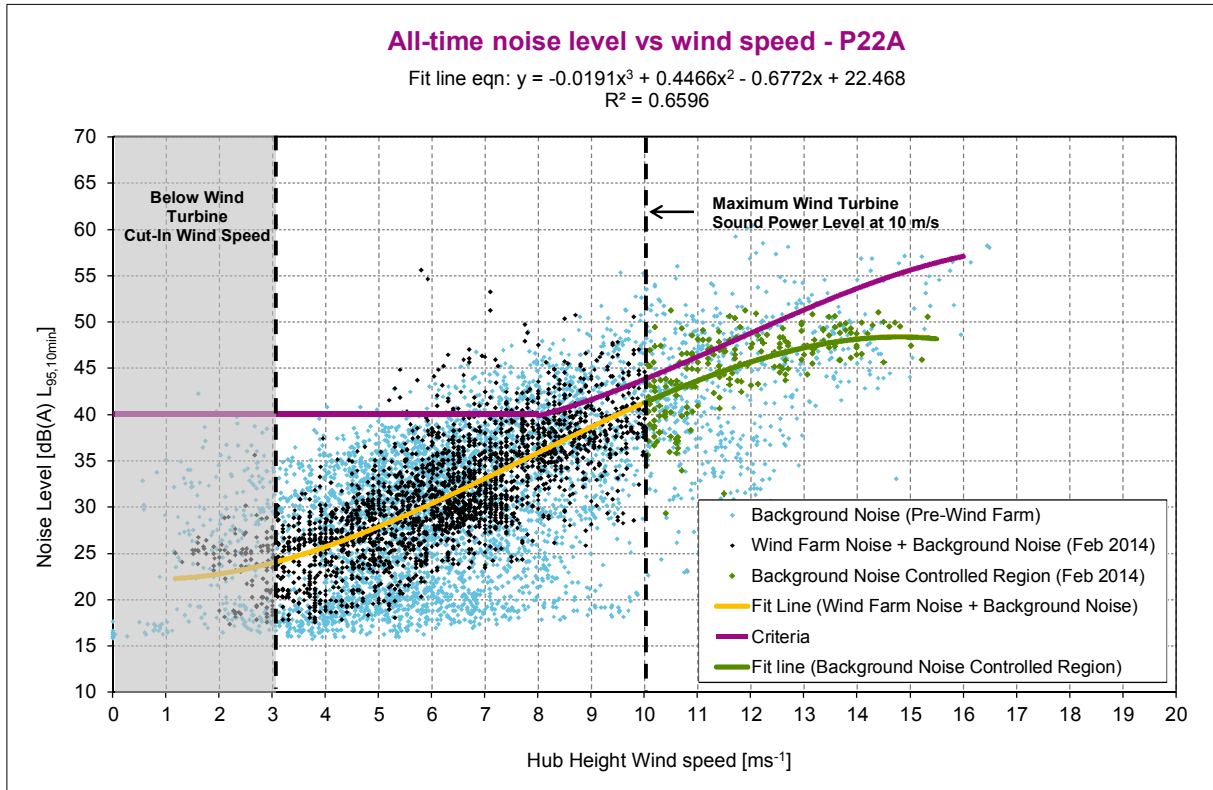


Figure 3 All-Time Monitoring Results – P22A

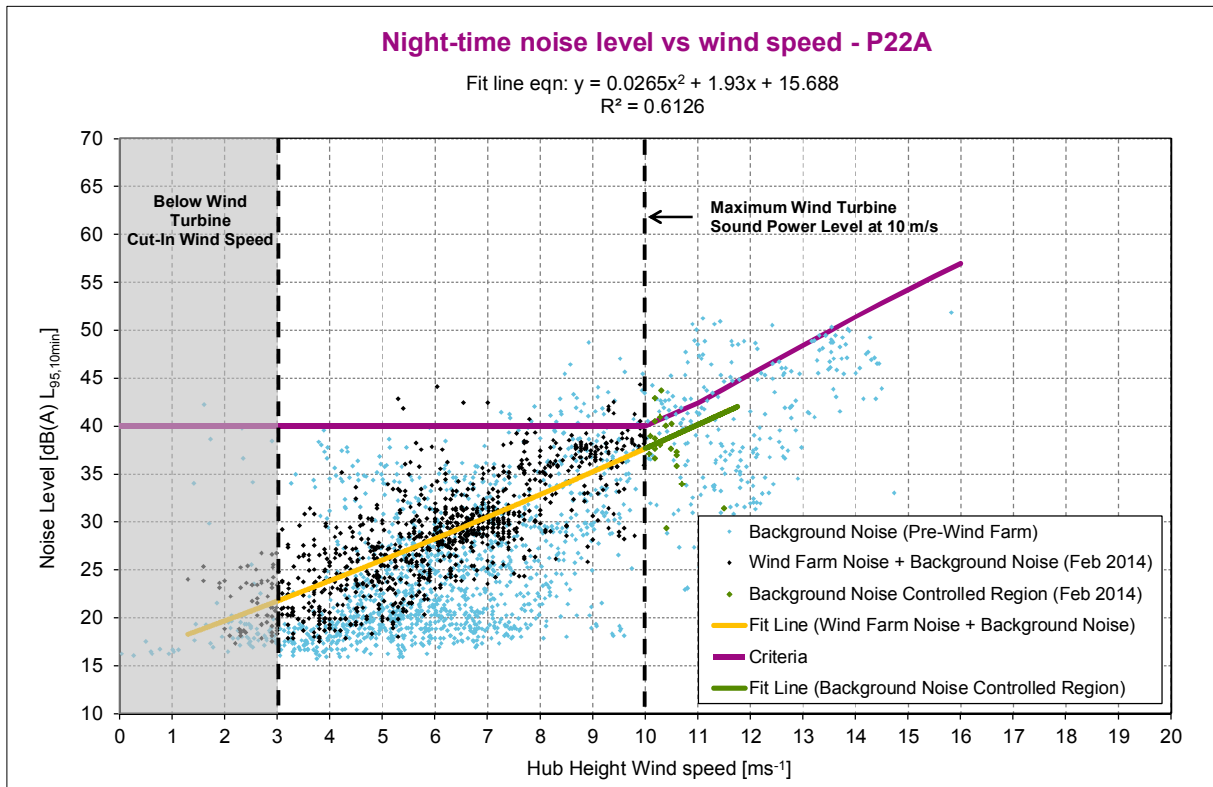


Figure 4 Night-Time Monitoring Results – P22A

Table 6 All-Time Monitoring Results – P22A

Wind Speed at Hub Height [m/s]	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
Background Noise Level [dB(A) L ₉₅]	24	24	24	25	26	27	29	31	34	36	39	41	44	46	48	50	52
Criterion [dB(A) L ₉₅]	n/a*	n/a*	n/a*	40	40	40	40	40	40	41	44	46	49	51	53	55	57
Measured Noise Level with Wind Turbines Operating [dB(A) L ₉₅]	n/a*	n/a*	n/a*	24 (31)	26 (31)	28 (32)	30 (34)	33 (35)	36 (37)	39 (39)	41 (41)	44** (43)	46** (45)	47** (48)	48** (50)	48** (51)	48** (53)
Compliance	n/a*	n/a*	n/a*	✓	✓	✓	✓	✓	✓	✓	✓	✓**	✓**	✓**	✓**	✓**	✓**
Compliance Margin, [dB(A) L ₉₅]	n/a*	n/a*	n/a*	16	14	12	10	7	4	2	3	**	**	**	**	**	**

* The wind turbines do not operate at wind speeds of less than 3 m/s.

** The wind turbine sound power levels do not increase at wind speeds above 10 m/s. Noise level increases above 10 m/s are due to wind-induced extraneous noise.

Note: The numbers shown in brackets below measured noise levels are the noise levels measured during the first round of noise compliance monitoring in February / March 2013.

The differences between the noise levels determined from each round of noise monitoring are considered to be due to differences in the acoustic environment, primarily due to natural variations in the wind and atmospheric conditions over the duration of each noise monitoring period, in combination with the statistical nature of the NZS 6808:1998 analysis method.

Table 7 Night-Time Monitoring Results – P22A

Wind Speed at Hub Height [m/s]	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
Background Noise Level [dB(A) L ₉₅]	20	19	19	20	21	23	24	27	29	32	34	37	40	43	46	49	52
Criterion [dB(A) L ₉₅]	n/a*	n/a*	n/a*	40	40	40	40	40	40	40	40	42	45	48	51	54	57
Measured Noise Level with Wind Turbines Operating [dB(A) L ₉₅]	n/a*	n/a*	n/a*	22 (33)	24 (33)	26 (33)	28 (33)	30 (34)	33 (35)	35 (37)	38 (39)	40** (41)	-	-	-	-	-
Compliance	n/a*	n/a*	n/a*	✓	✓	✓	✓	✓	✓	✓	✓	✓**	✓**	✓**	✓**	✓**	✓**
Compliance Margin, [dB(A) L ₉₅]	n/a*	n/a*	n/a*	18	16	14	12	10	7	5	2	**	**	**	**	**	**

* The wind turbines do not operate at wind speeds of less than 3 m/s.

** The wind turbine sound power levels do not increase at wind speeds above 10 m/s. Noise level increases above 10 m/s are due to wind-induced extraneous noise.

Note: The numbers shown in brackets below measured noise levels are the noise levels measured during the first round of noise compliance monitoring in February / March 2013.

The differences between the noise levels determined from each round of noise monitoring are considered to be due to differences in the acoustic environment, primarily due to natural variations in the wind and atmospheric conditions over the duration of each noise monitoring period, in combination with the statistical nature of the NZS 6808:1998 analysis method.

7.2.2 V16A

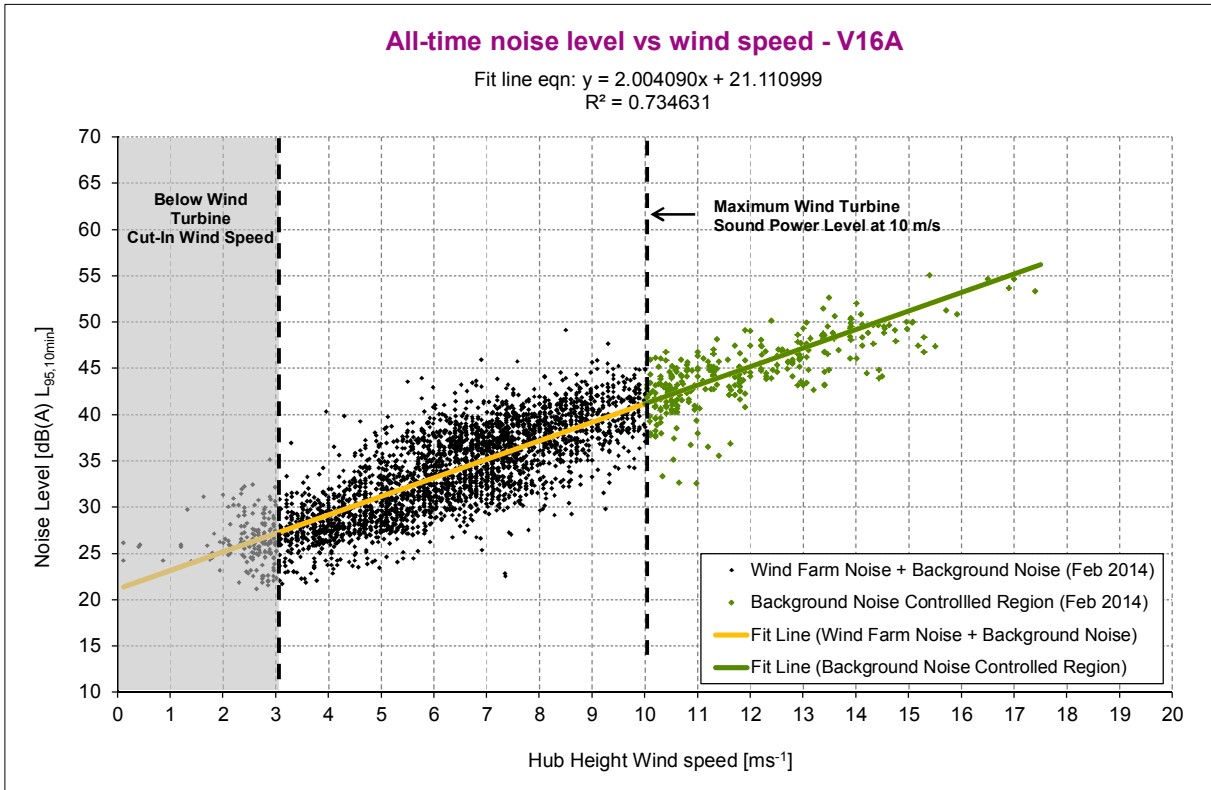


Figure 5 All-Time Monitoring Results – V16A

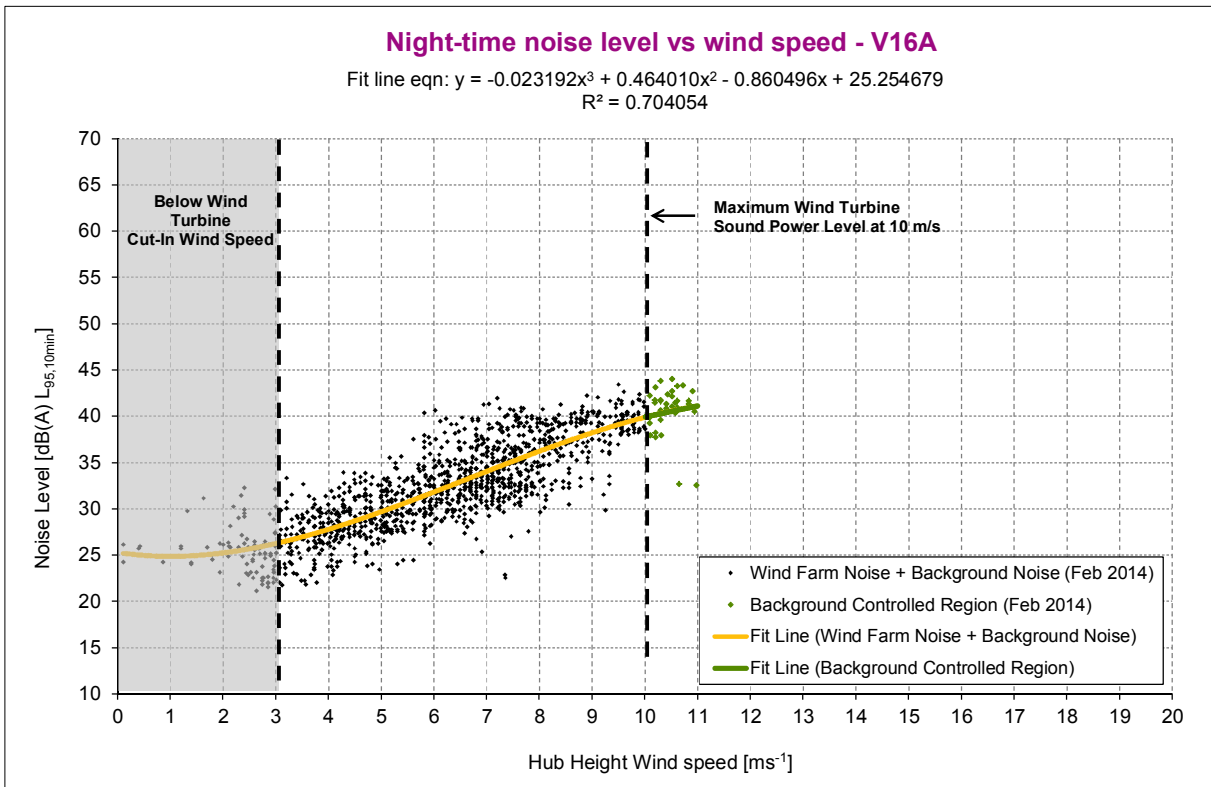


Figure 6 Night-Time Monitoring Results – V16A

Table 8 All-Time Monitoring Results – V16A

Wind Speed at Hub Height [m/s]	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
Background Noise Level [dB(A) L ₉₅] ^{***}	-	-	-	28	28	29	30	31	33	35	37	40	42	45	48	51	54	57
Criterion [dB(A) L ₉₅] ^{****}	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Measured Noise Level with Wind Turbines Operating [dB(A) L ₉₅]	n/a*	n/a*	n/a*	27 (34)	29 (35)	31 (36)	33 (37)	35 (38)	37 (39)	39 (40)	41 (41)	43** (42)	45** (43)	47** (44)	49** (45)	51** (47)	53** (48)	55** (49)

Table 9 Night-Time Monitoring Results – V16A

Wind Speed at Hub Height [m/s]	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
Background Noise Level [dB(A) L ₉₅] ^{***}	-	-	-	26	25	25	25	26	28	30	32	35	37	38	40	41	41	40
Criterion [dB(A) L ₉₅] ^{****}	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Measured Noise Level with Wind Turbines Operating [dB(A) L ₉₅]	n/a*	n/a*	n/a*	26 (36)	28 (36)	30 (37)	32 (37)	34 (38)	36 (39)	38 (40)	40 (41)	41** (41)	-	-	-	-	-	-

* The wind turbines do not operate at wind speeds of less than 3 m/s.

** The wind turbine sound power levels do not increase at wind speeds above 10 m/s. Noise level increases above 10 m/s are due to wind-induced extraneous noise.

*** The background noise levels presented are the original background noise levels from the Hayes McKenzie Report (May 2005)

**** No criteria are applicable for this location as the dwelling has been decommissioned and the land is understood to be subject to a restrictive covenant preventing the development or construction of any dwelling in the future.

Note: The numbers shown in brackets below measured noise levels are the noise levels measured during the first round of noise compliance monitoring in February / March 2013.

The differences between the noise levels determined from each round of noise monitoring are considered to be due to differences in the acoustic environment, primarily due to natural variations in the wind and atmospheric conditions over the duration of each noise monitoring period, in combination with the statistical nature of the NZS 6808:1998 analysis method.

7.3 Discussion of Results

The planning permit requirement for Macarthur Wind Farm sets a noise limit for the wind farm of the greater of 40 dB(A) or 5 dB(A) above the background noise level when assessed in accordance with NZS 6808:1998. This limit is for the wind farm only noise, whereas, the assessment compares the combined background noise and wind farm noise levels to the assessment criteria. The approach taken in the assessment is therefore conservative because the combined background noise levels and wind farm noise levels would be higher than the wind farm noise levels alone, and in many cases the noise environment at the reference locations would have been dominated by the background noise.

Based on the graphs of the combined background noise and wind farm noise presented above, the results of the noise monitoring demonstrate that the Wind Farm is compliant with the noise criteria.

For some wind speeds, the measured noise levels in this round of monitoring differ from the previous round in February / March 2013. This is considered to be due to natural differences in the wind and weather conditions between the two monitoring rounds, the associated differences in the background noise levels, and the effect of these differences when combined with the statistical nature of the NZS 6808:1998 analysis method.

8.0 Assessment of Special Audible Characteristics

8.1 Introduction

Pursuant to Conditions 16 b) and 25 of the Planning Permit, an assessment has been undertaken in accordance with NZS 6808:1998 to establish whether a penalty adjustment may be applicable for any special audible characteristics (SACs).

8.2 Special Audible Characteristics

Section 5.3.1 of NZS 6808:1998 defines SACs as being:

- 1) Clearly audible tones
- 2) Impulses; and
- 3) Modulation of sound levels.

Tones occur where the sound under consideration has energy concentrated at certain frequency (pitch), like a single note on a musical instrument.

Impulse sound, if present, would be heard as banging or thumping noises from the Wind Farm.

Modulation of sound level (amplitude modulation) is where the sound from the Wind Farm exhibits a regularly varying level greater than that characteristic of 'normal' wind turbine operation. 'Normal' wind turbine operation is generally acknowledged as including some minor amplitude modulation due to 'swishing' noise from the blades. The noise limits prescribed by wind farm noise criteria generally take this minor amplitude modulation into account. Although NZS 6808:1998 does not specifically state this to be the case, it is clearly stated in the current version of the standard, NZS 6808:2010.

8.3 Assessment Procedure

In accordance with the requirements of Section 5.3.1 of NZS 6808:1998, subjective assessments of the Wind Farm noise were undertaken at each reference location, in order to determine if the noise from the Wind Farm exhibits any special audible characteristics that may require a penalty adjustment to be applied.

Five subjective assessments of the wind farm noise were undertaken at each noise monitoring location during the monitoring period. Each subjective assessment of the wind farm noise was conducted by a professional acoustic engineer (grade Member of the Australian Acoustical Society), as per the process below:

- An acoustic engineer listened to the sound at the reference location for a minimum period of 10 minutes;
- As far as practical, the listening position was the same as the noise logger position used for measurement of the 'A'-weighted sound pressure levels;
- The sounds at the reference location were noted, including any sound from the Wind Farm and any SACs due to the Wind Farm;
- The sound pressure levels during the subjective assessment were measured using a laboratory calibrated Bruel and Kjaer 2250 Class 1 Sound Level Meter (Serial Number 2600404). A copy of the calibration certificate for this Sound Level Meter is presented in Appendix F;
- The sounds present during the assessment were recorded to a wave file by the Sound Level Meter, to provide an audio record of the period, and to enable subsequent objective analysis if required;
- The local wind conditions at the reference locations during the assessment period were noted subjectively;
- The wind conditions at the Wind Farm were determined (after the assessment) from the relevant met mast data corresponding to the same time period as the assessment.

8.4 Summary of Findings

The subjective assessments of special audible characteristics which were conducted during this second round of noise monitoring were performed under a range of wind conditions covering wind speeds of approximately 4 to 9 m/s at hub height, and wind directions from SE to SW. As such on most of the occasions when subjective assessments were performed, P22A was generally in a crosswind position with respect to the Wind Farm, with a slight upwind or downwind component. V16A was generally in a downwind or slightly off downwind position from the nearest turbines.

The wind farm noise was observed to be audible during at least one subjective assessment at each location. However, for the majority of the subjective assessments the wind farm noise was inaudible at P22A or only faintly audible. At V16A the wind farm noise was generally audible.

No tones or other special audible characteristics were audible during any of the subjective assessments at the reference locations considered.

In summary, special audible characteristics have not been determined to be present at any of the reference locations. Therefore, it is determined that no penalty adjustment for special audible characteristics is applicable. This is consistent with the findings of the earlier subjective assessments performed during the initial noise compliance monitoring in February and March 2013.

9.0 Conclusion

The noise emissions from Macarthur Wind Farm have been assessed in accordance with the requirements of the Macarthur Wind Farm Planning Permit and the Standard, NZS 6808:1998 “*Acoustics – The Assessment and Measurement of Sound from Wind Turbine Generators*”.

Unattended noise compliance monitoring was undertaken during January and February, 2014 to determine the wind farm noise levels at the reference locations required in accordance with the Planning Permit.

At each reference location, the wind farm noise levels at each integer wind speed were measured to comply with the applicable noise criteria.

Pursuant to the Standard, subjective assessments of the Wind Farm noise were undertaken at each reference location during the monitoring period, in order to determine if the noise from the wind farm exhibits any special audible characteristics (SACs) that may require a penalty adjustment to be applied. A minimum of five subjective assessments in representative operating conditions were undertaken at each reference location.

Special audible characteristics have not been determined to be present at any of the reference locations. Therefore, it is determined that no penalty adjustment for special audible characteristics is applicable.

Based on the noise monitoring and assessments that have been conducted, as outlined in this report and the previous noise compliance monitoring report, the noise emissions from Macarthur Wind Farm comply with the acoustic requirements of the Macarthur Wind Farm Planning Permit.

Appendix A

Glossary of Terms


Appendix A Glossary of Terms

A-weighting	The A-weighting scale is used to adjust the sound pressure levels measured in decibels to more accurately reflect the subjective response of the human ear to sound. The human ear is less sensitive to low frequency (pitch) sounds than sounds of middle to high frequency. That is, low frequency sounds of the same decibel level are not heard as loud as high frequency sounds. A sound level meter replicates the human response of the ear by using an electronic filter which is called the A-weighting filter. A sound level measured with this filter switched on is denoted as dB(A).
dB(A)	The unit of A-weighted sound pressure level.
L _{95(10min)}	The A-weighted sound pressure level exceeded for 95% of a 10 minute measurement period. This descriptor is used to represent the background noise levels and the wind farm noise levels under NZS 6808:1998.
Sound Power Level	A measure of the total sound energy emitted by a source. Mathematically, it is ten times the logarithm to the base ten of the ratio of the sound power of a source to the reference sound power; where sound power is defined as the total sound energy radiated per unit time (W), and the reference sound power is 1×10^{-12} W. [Unit: Decibels]
Sound Pressure Level	A measure of the magnitude of a sound wave. Mathematically, it is twenty times the logarithm to the base ten of the ratio of the root mean square sound pressure at a point in a sound field, to the reference sound pressure; where sound pressure is defined as the alternating component of the pressure (Pa) at the point, and the reference sound pressure is 2×10^{-5} Pa. [Unit: Decibels]

Appendix B

Site Layout

Appendix B Site Layout

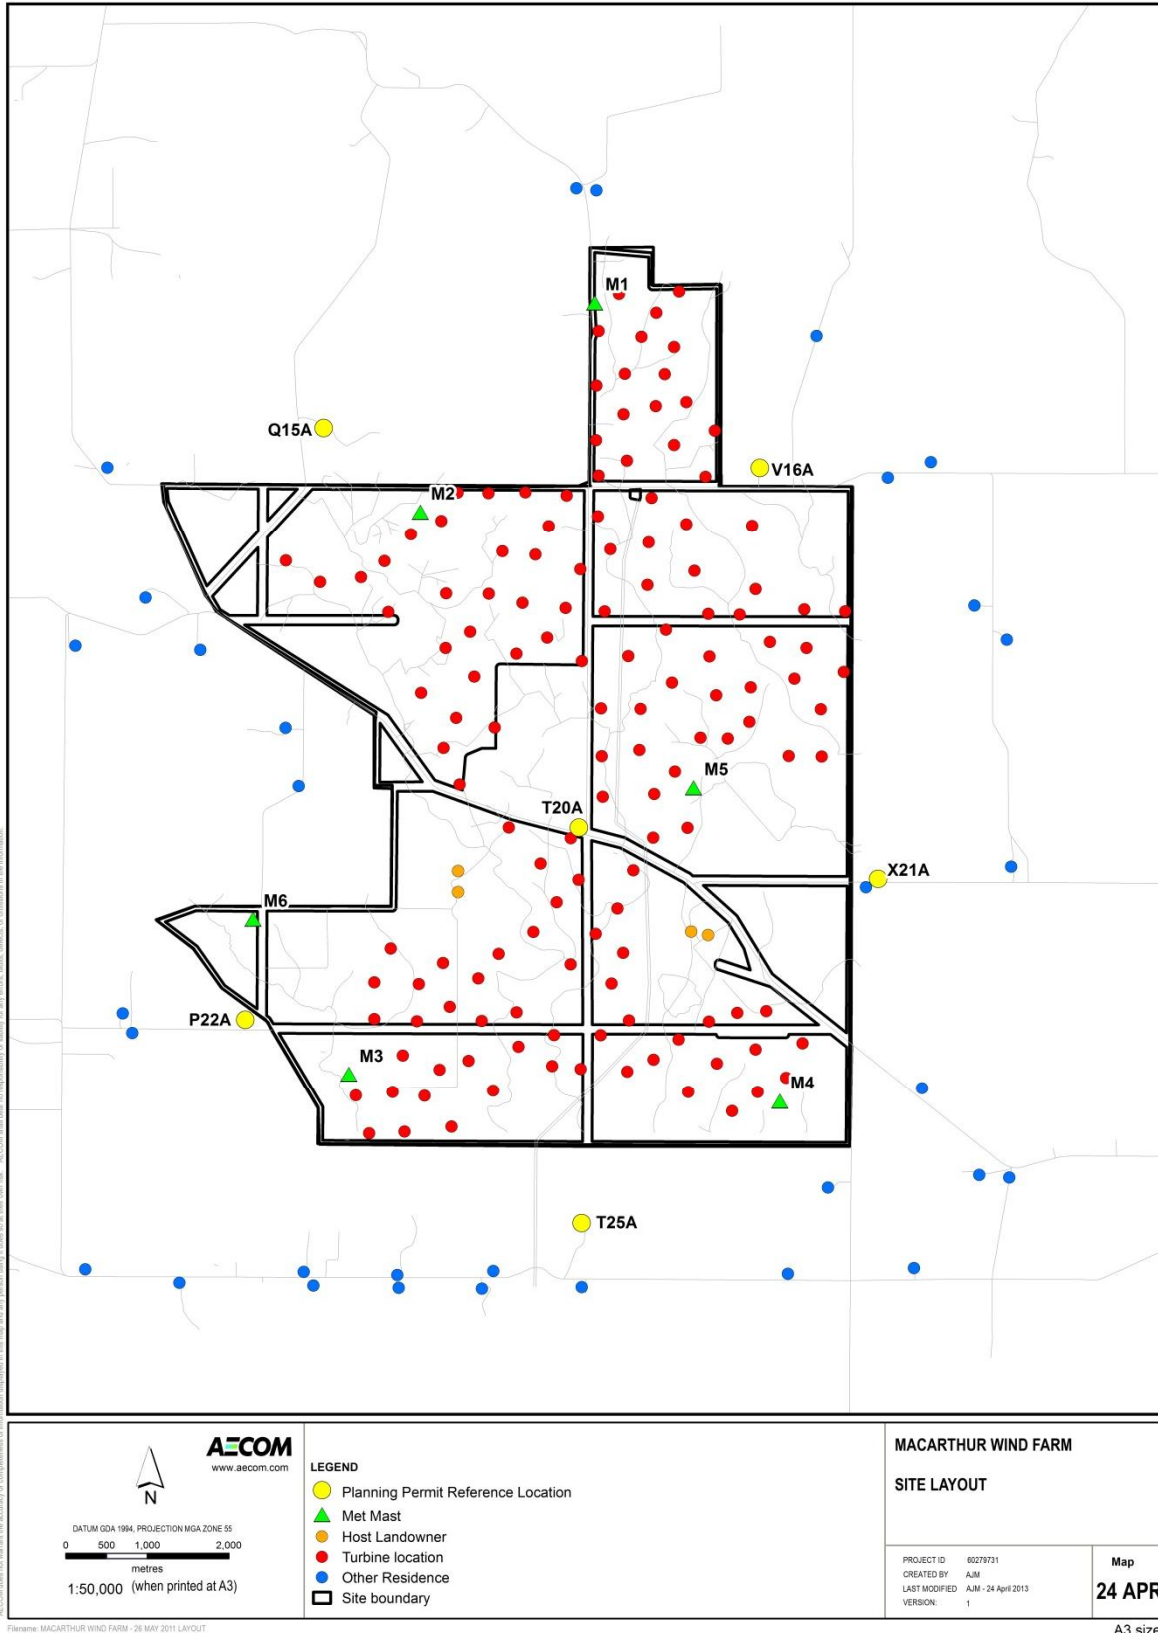

Appendix C

Wind Turbine Details

Appendix C Wind Turbine Details

The following tables provide general details of the wind turbines installed at Macarthur Wind Farm:

Table 10 General Details of Macarthur Wind Farm Wind Turbines

Make:	Vestas	
Model:	V112 3MW	
Rated Power Output	3 MW	
Number of Blades:	3	
Rotor Diameter:	112m	
Hub Height:	84m	
Rotational Speed	4.4 to 17.7 rpm	
Rotational Direction	Clockwise	
Cut-in Wind Speed*	3 m/s	
Cut-out Wind Speed*	25 m/s	

* Hub-height wind speed

Table 11 Sound Power Levels of Vestas V112 3MW, Operating Mode 0
(Source: Vestas General Specification, V112-3.0MW, IEC IIA, T05 Item No. 0004-7993 V02, dated 2009-12-03)

Conditions for Sound Power Level Measurement	Standard: IEC 61400-11 Ed. 2, 2002 Wind shear: 0.16 Max. turbulence at 10 meter height: 16% Inflow angle (vertical): 0 ± 2° Air density: 1.225 kg/m³ HH 94 m
L _{WA} @ 3 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	95.0 4.3
L _{WA} @ 4 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	97.7 5.7
L _{WA} @ 5 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	102.5 7.2
L _{WA} @ 6 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	105.7 8.6
L _{WA} @ 7 to 25 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	106.5 10
L _{WA} @ 8 to 25 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	106.5 11.5
L _{WA} @ 9 to 25 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	106.5 12.9
L _{WA} @ 10 to 25 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	106.5 14.3
L _{WA} @ 11 to 25 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	106.5 15.8
L _{WA} @ 12 to 25 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	106.5 17.2
L _{WA} @ 13 to 25 m/s (10 m above ground) [dBA] Wind speed at HH [m/sec]	106.5 18.6

Appendix D

Planning Permit Noise Conditions

Planning and Environment Regulations 2005 Form 11

Section 97F

**PLANNING PERMIT GRANTED BY THE MINISTER UNDER
DIVISION 6 OF PART 4 OF THE PLANNING AND ENVIRONMENT ACT 1987**

- f) a timetable for implementation of all landscaping works; and
 - g) a maintenance and monitoring program.
14. The use and development must be carried out in accordance with the endorsed On-site and Off-site Landscape Plans.
15. A copy of the approved Landscape Plan must also be given to those landowners of land where planting is proposed to be included in the Landscape Plan. Where non-contracted landowners elect to defer a decision on planting until after the wind turbines have been constructed, the development plans shall be amended to include any such agreed planting, and resubmitted to the responsible authority for approval

NOISE STANDARD

16. The operation of the wind energy facility must comply with the New Zealand Standard 'Acoustics – The Assessment and Measurement of Sound from Wind Turbine Generators' (NZS 6808:1998) (the 'Standard'), at any dwelling existing in the vicinity of the wind energy facility as at 7 February 2006. In determining compliance with the Standard, the following shall apply:
- a) The sound level from the operating wind energy facility, measured outdoors within 10 metres of a dwelling at any relevant nominated wind speed, shall not exceed the background level (L_{95}) by more than 5dBA or a level of 40dBA L_{95} , whichever is the greater. This 'background sound level' shall be determined by the method specified in NZS 6806:1998. Compliance shall be determined separately for all time data and for night time data. Night time is defined as 10pm to 7am.
 - b) If sound has a special audible characteristic the measured sound level of the source shall have a 5 dB penalty applied. The EMP must provide detail on how special audible characteristics are to be determined and the penalty is to be applied
17. Condition 16 does not apply to any dwelling on land on which part of the wind energy facility is erected. That exemption shall be given affect through an agreement with the landowner that shall apply to any occupant of the dwelling and must be registered on the title to the land.
18. Prior to any construction work commencing a detailed investigation shall be carried out at the background noise monitoring location identified as 'Location 7' being at the dwelling identified as 'T20A', to ascertain the apparent extraneous noise sources that prevented a reliable determination of background noise being achieved at this site. The location is identified in Report No 03.543-01 in Supplement A of the Planning Permit Application Report dated July 2005.
19. The existing data shall either be corrected, if that is possible and provides sufficient number of data points, or further background noise measurements made, subject to the approval of the owner, with those extraneous noise sources excluded. The Preliminary Environmental Management Plan dated 3 March 2006 provides further detail on this matter.

Planning and Environment Regulations 2005 Form 11**Section 97F****PLANNING PERMIT GRANTED BY THE MINISTER UNDER
DIVISION 6 OF PART 4 OF THE PLANNING AND ENVIRONMENT ACT 1987****NOISE COMPLIANCE ASSESSMENT**

20. A post-construction noise monitoring and compliance assessment program must be undertaken by the wind energy facility operator. This must be to the satisfaction of the responsible authority with regard to timing, program design, determination of compliance, any necessary remedial action, and information dissemination. The PEMP provides more detailed requirements on this.
21. The initial compliance noise monitoring program must commence within 2 months of the commissioning of the last turbine in the wind energy facility or, if the facility is constructed in groups of turbines, separate programs within 2 months of the commissioning of each group. The date at which 'commissioning' has been deemed to occur and the extent of the noise compliance monitoring shall be agreed between the responsible authority and the wind energy facility operator.
22. After the complete wind energy facility is commissioned the monitoring shall be carried out at all six reference dwellings used to measure background sound levels, subject to the approval of their owners.
23. The location shall be monitored concurrently, and with the wind turbines operating in their normal mode. As far as possible the noise meter calibration and noise monitoring program shall be carried out by organisations accredited with the National Association of Testing Authorities (NATA).
24. The design of the program and the evaluation of the acoustic data must be carried by an independent expert who has had experience in the analysis, interpretation and presentation of acoustic data from wind turbines, and who is preferably a member of a recognised professional association in that field.
25. Compliance at noise reference locations is determined by comparing the curve of the operational wind farm noise results, to which has been arithmetically added the 5 dB penalty for any special audible characteristics should such be required, with the noise criterion curves for each site and for each time period. Compliance is demonstrated by the noise curve for the operational wind farm falling below the noise criterion curve at all wind speeds.
26. Should compliance be demonstrated by the program above the compliance noise monitoring program must be repeated commencing not less than 10 months and not greater than 12 months after the commencement of the initial compliance noise monitoring program for the whole site. Should that further monitoring program demonstrate compliance with the noise criteria no further noise compliance monitoring shall be required at those locations unless otherwise determined by the responsible authority.
27. The responsible authority may require noise compliance monitoring at a dwelling or dwellings other than those reference dwellings of condition 22 above on the basis of a reasonable belief that noise criteria may not be being complied with.

NOISE COMPLIANCE ENFORCEMENT

28. If the initial monitoring of any stage of the wind energy facility of the complete facility shows non-compliance with the noise criterion for any location or time period

Planning and Environment Regulations 2005 Form 11

Section 97F

**PLANNING PERMIT GRANTED BY THE MINISTER UNDER
DIVISION 6 OF PART 4 OF THE PLANNING AND ENVIRONMENT ACT 1987**

the operator will, within 30 days of submitting the compliance monitoring report, provide to the responsible authority, and make publicly available a detailed plan, including time lines, of actions proposed to be taken to secure compliance. Details on what might be included in such a plan should be provided in the EMP.

29. Within 60 days of approval by the responsible authority of the plan to remedy any such breach of environmental noise criteria, the operator will implement those actions that are possible within the time period and any additional interim actions, pending longer term modifications, to bring the wind energy facility into noise compliance.
30. Within 30 days of completing all the noise reduction actions in condition 29 above the operator must commence a further noise monitoring program as described in conditions 20 to 27 above, but only at those sites and for those time periods for which compliance had not been demonstrated.
31. Reports of the noise monitoring and investigation programs shall be provided to the responsible authority and made publicly available within 60 days of the completion of each monitoring stage or investigation program. The reports will be written so as to be accessible by lay persons, with appendices as needed to contain the more technically detailed material. Detail on this provision of information must be provided in the EMP.

NOISE COMPLAINTS

32. Before commissioning the first group of turbines of the wind energy facility a complaints evaluation and response process must be developed by the wind energy facility operator, and be submitted to the responsible authority for approval. The draft of the proposed process must be made available for comment to occupiers of dwellings within 5km of the nearest wind turbine.
33. The specific matters that should be included in the complaints, evaluation and response process must be provided in the EMP.

BLADE SHADOW FLICKER

34. Shadow flicker from the wind energy facility must not exceed 30 hours per annum at any dwelling existing prior to 26th October 2006.

This condition does not apply to any dwelling on land on which part of the wind energy facility is erected. (This exemption will be given effect through an agreement with the landowner that will apply to any occupant of the dwelling).

35. Before the use starts, details of a complaint evaluation and response process must be submitted to and approved by the Minister for Planning to assess any alleged breach of Condition 34. Thereafter, the use must be carried out in accordance with the approved process and alleged breaches identified by this process must be addressed to the satisfaction of the Minister for Planning.

TELEVISION RECEPTION AND INTERFERENCE

36. A pre-construction survey shall be offered to residents at all dwellings up to 3kms from a wind turbine to determine television reception strength. The proponent shall

Appendix E

Noise Monitoring Positions

P22A



Figure 7 Noise Logger Position at P22A (North at Top of Page, Wind Farm to East)



Figure 8 View to North at P22A



Figure 9 View to West at P22A



Figure 10 View to South at P22A



Figure 11 View to East at P22A

V16A



Figure 12 Noise Logger Position at V16A (North to Top of Page, Wind Farm to West and South)



Figure 13 View to North at V16A



Figure 14 View to West at V16A




Figure 15 View to South at V16A





Figure 16 View to East at V16A

Appendix F

Calibration Certificates

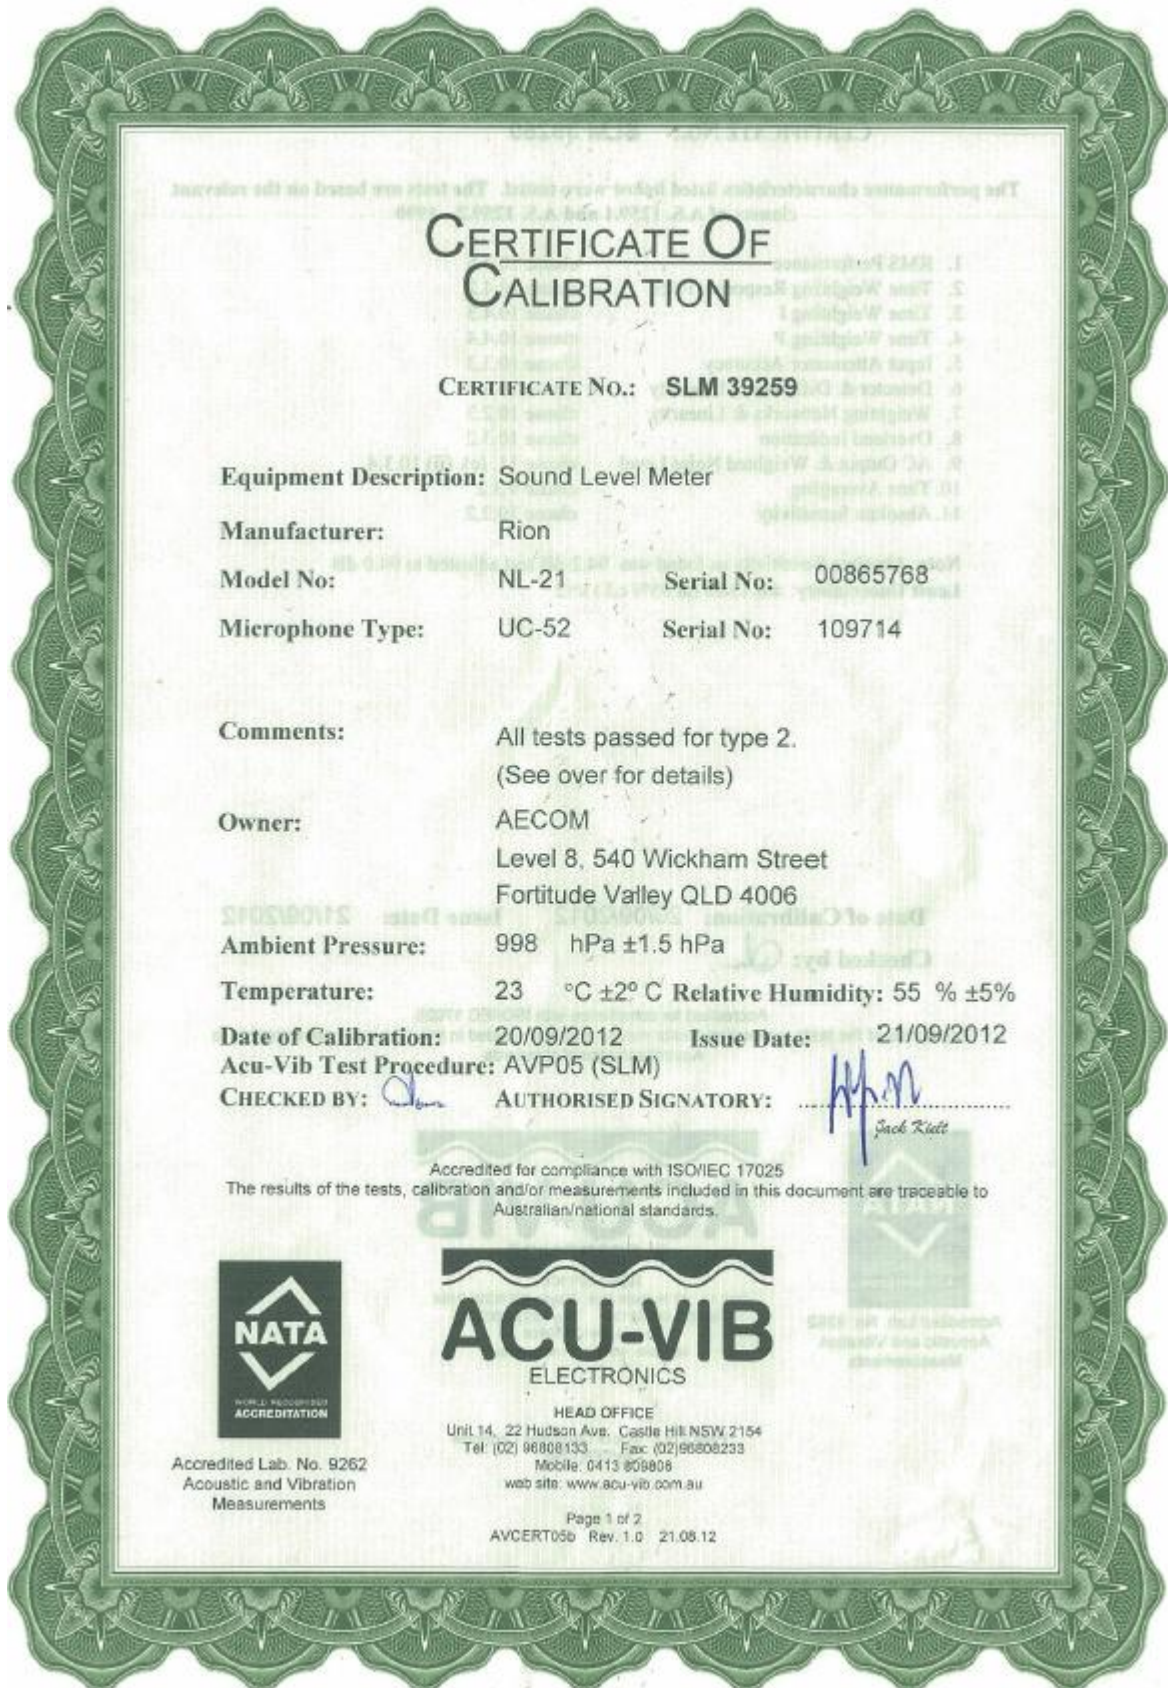

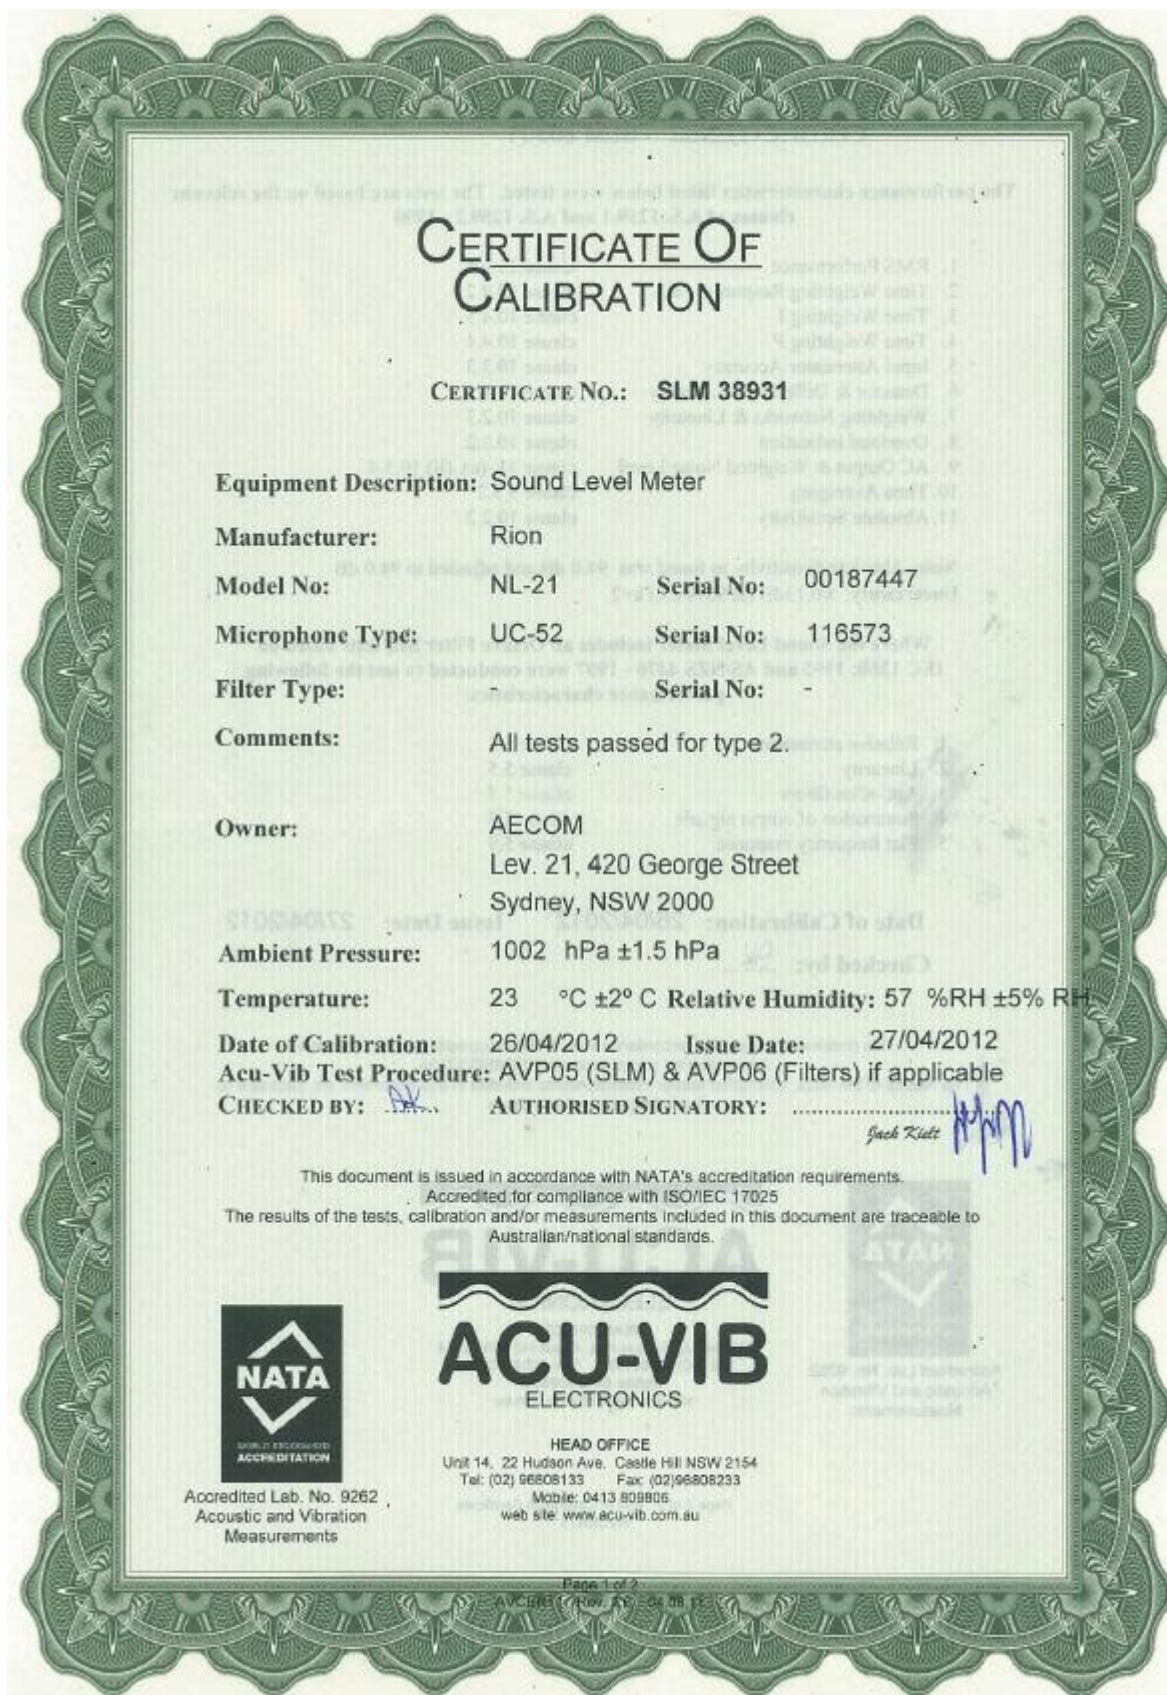

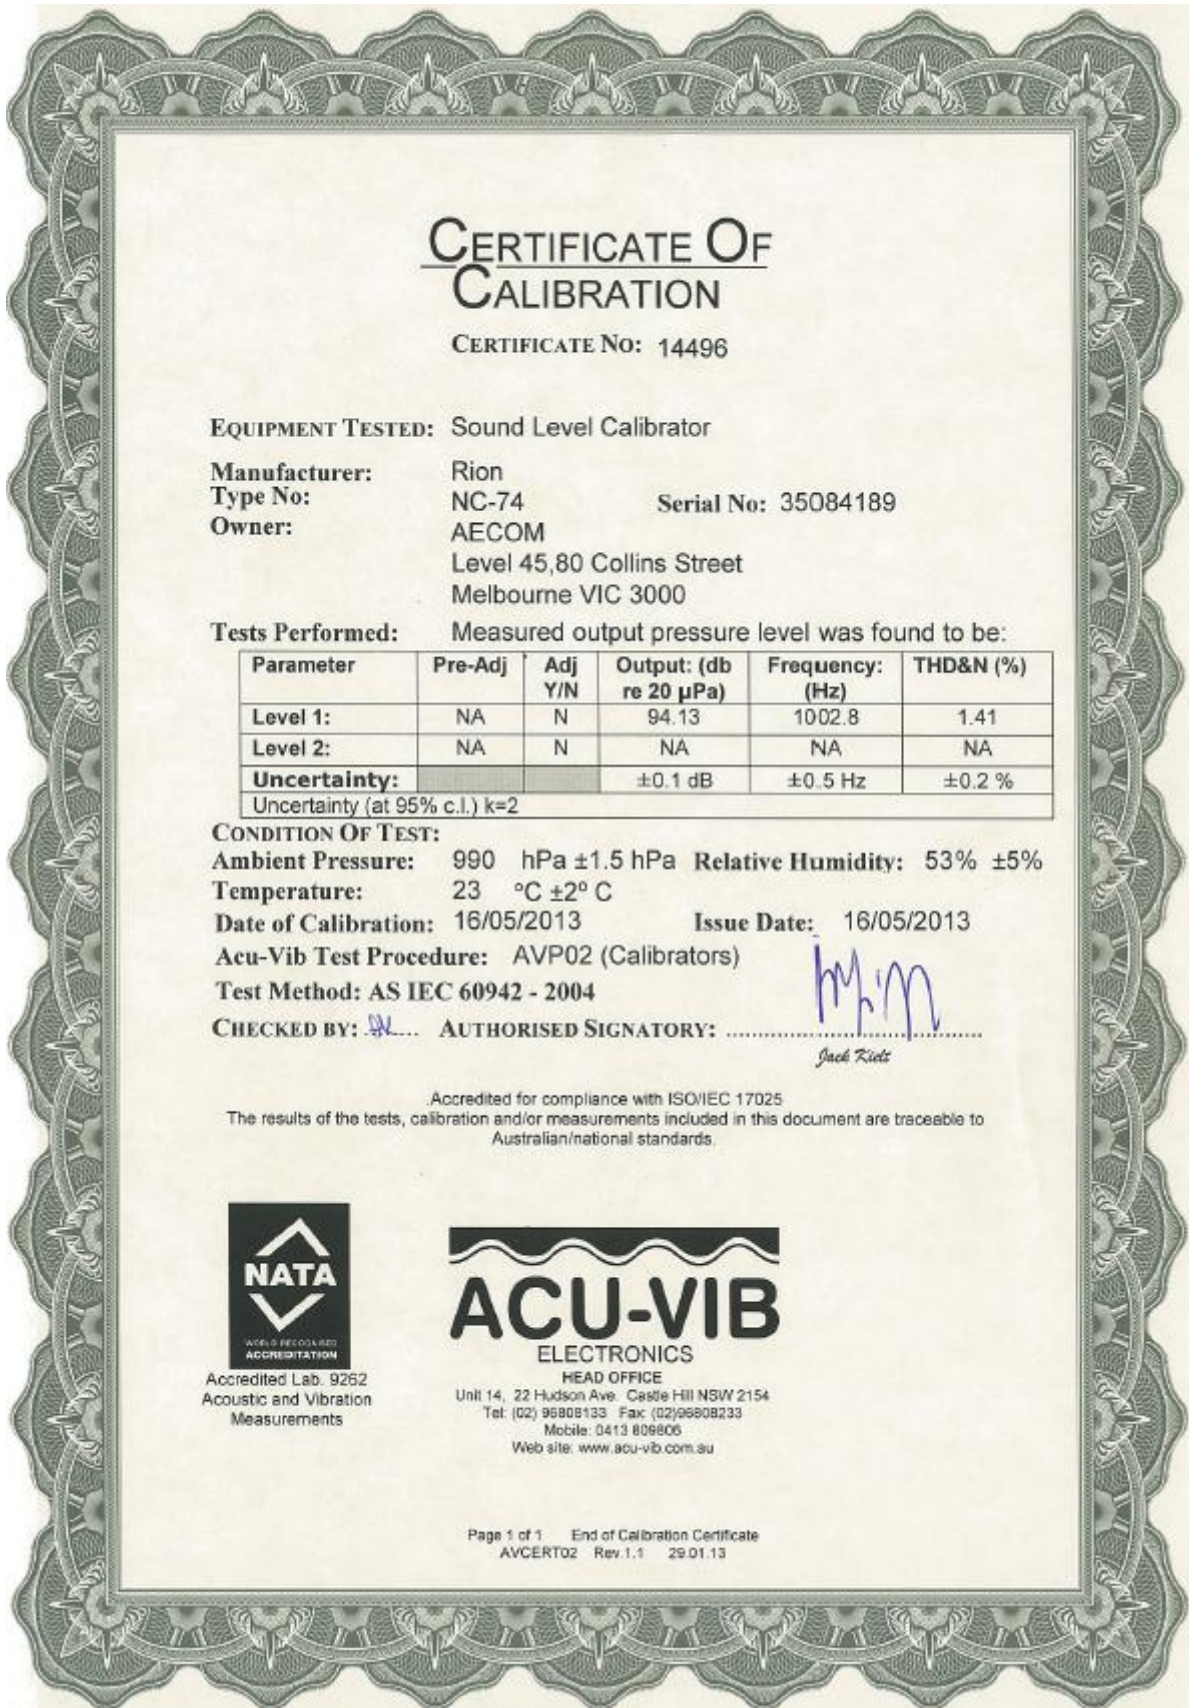

CERTIFICATE OF CALIBRATION

CERTIFICATE NO: 14496

EQUIPMENT TESTED: Sound Level Calibrator

Manufacturer: Rion
Type No: NC-74 **Serial No:** 35084189
Owner: AECOM
 Level 45,80 Collins Street
 Melbourne VIC 3000

Tests Performed: Measured output pressure level was found to be:

Parameter	Pre-Adj	Adj Y/N	Output: (db re 20 µPa)	Frequency: (Hz)	THD&N (%)
Level 1:	NA	N	94.13	1002.8	1.41
Level 2:	NA	N	NA	NA	NA
Uncertainty:			±0.1 dB	±0.5 Hz	±0.2 %
Uncertainty (at 95% c.i.) k=2					

CONDITION OF TEST:

Ambient Pressure: 990 hPa ±1.5 hPa **Relative Humidity:** 53% ±5%
Temperature: 23 °C ±2° C

Date of Calibration: 16/05/2013 **Issue Date:** 16/05/2013

Acu-Vib Test Procedure: AVP02 (Calibrators)

Test Method: AS IEC 60942 - 2004

CHECKED BY: *[Signature]* **AUTHORISED SIGNATORY:** *[Signature]*
Jack Riets


Accredited for compliance with ISO/IEC 17025
 The results of the tests, calibration and/or measurements included in this document are traceable to Australian/national standards.



Accredited Lab. 9262
 Acoustic and Vibration
 Measurements



HEAD OFFICE
 Unit 14, 22 Hudson Ave. Castle Hill NSW 2154
 Tel: (02) 96808133 Fax: (02)96808233
 Mobile: 0413 809806
 Web site: www.acu-vib.com.au

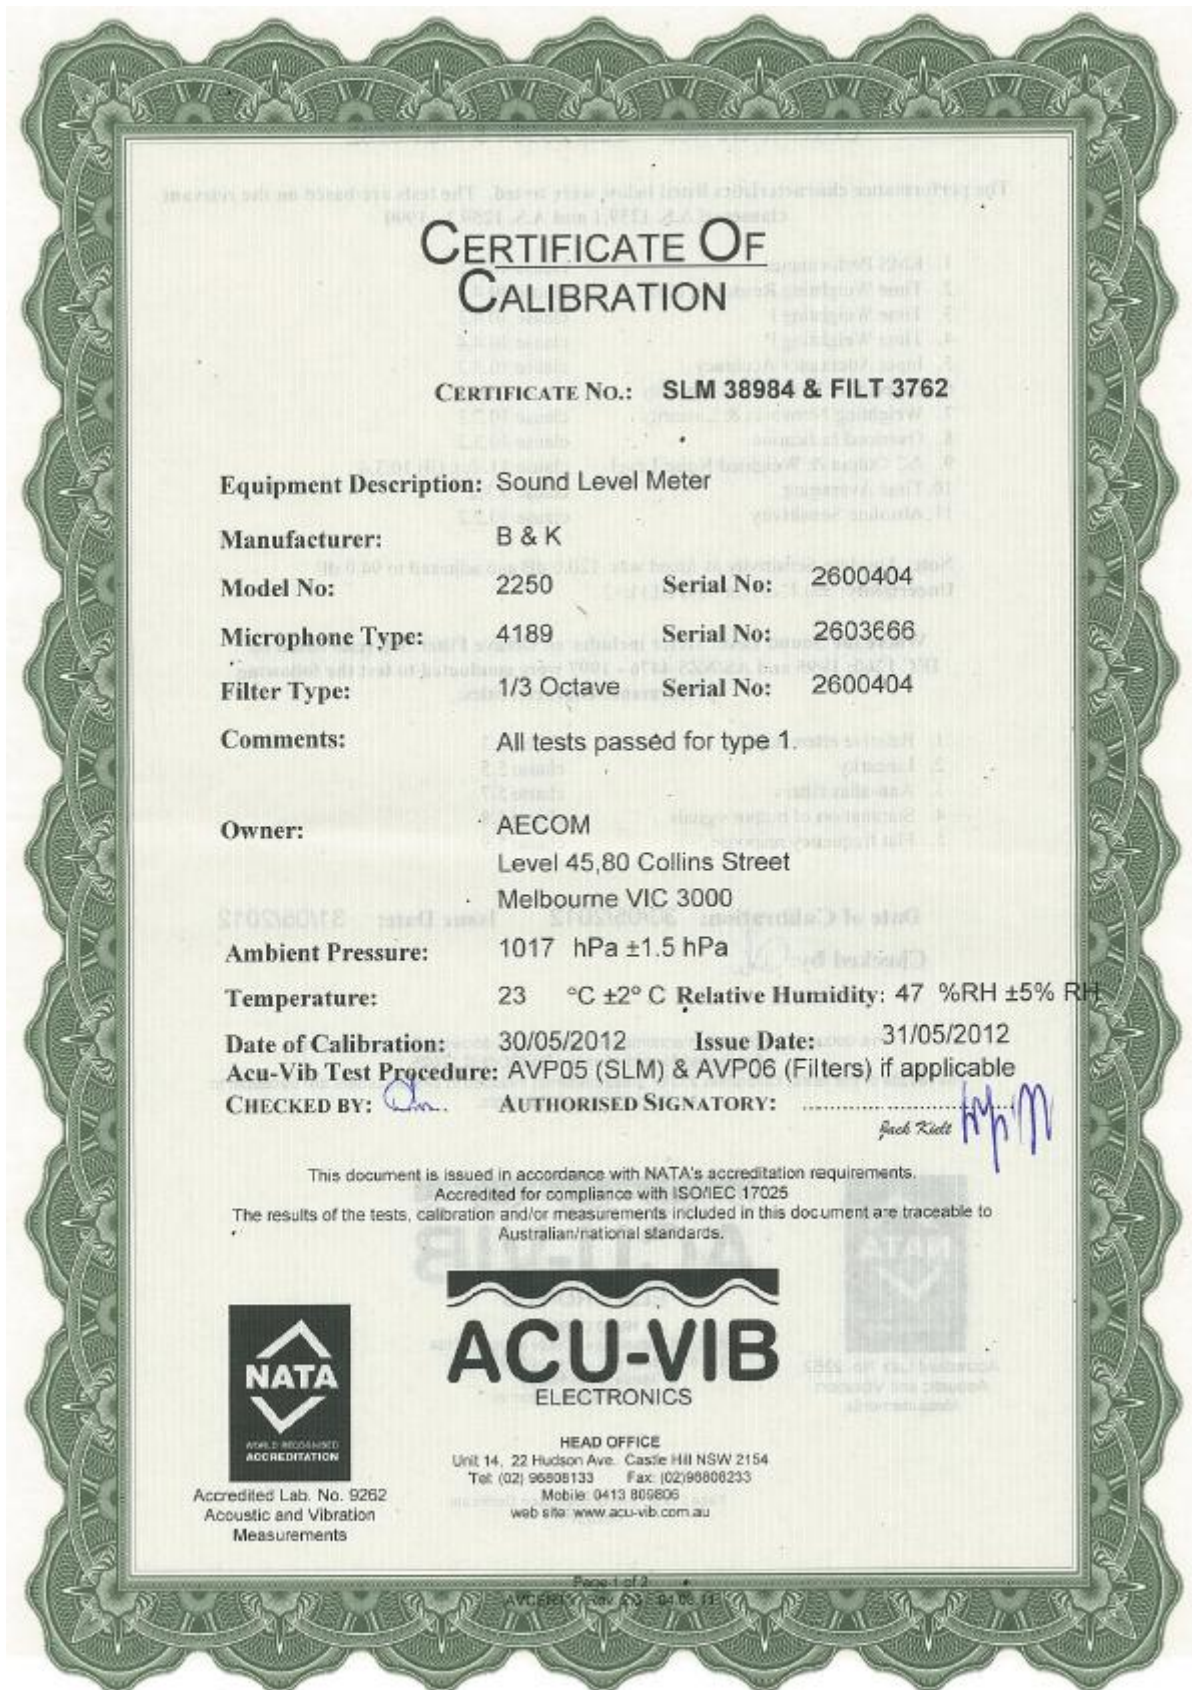

Appendix G

Method for Determining Wake-Free Wind Data

Appendix G Method for Determining Wake-Free Wind Data

Met Mast Selection and Wind Speed Determination

The nature of the Wind Farm layout means that all the met masts are located at positions where they may be affected by the wake of the wind turbines for certain wind directions.

To maintain consistency with the background noise curves, and satisfy the requirements of Section 4.5.4 of NZS 6808:1998, the wind data must be wake free.

The wind speed data used for the noise analysis was derived from a combination of the six met masts to ensure that all data used was not wake affected. A procedure for deriving wake free wind data was recommended by the project's wind analyst, Garrad Hassan, and selection of the wind data was undertaken in accordance with that procedure.

The procedure can be summarised as follows:

- A lead met mast is selected from either M1, M4 or M6, based on whichever of those masts is the closest to the reference location;
- The wind direction measured at the lead met mast is used to determine whether the mast was in the wake of the wind turbines for any particular time interval.
- For periods where the lead mast is determined to be in the wake of the wind turbines, wind speed data is taken from an alternative met mast that is not in the wake of the wind turbines for that particular wind direction.
- A directional correlation ratio that has been derived between the two met masts is then applied to adjust the wind speed from the alternative met mast to the equivalent wind speed at the lead met mast.
- In this manner, a composite times series of wind speed data from wake free met masts is synthesised and related back to the lead met mast location.

The lead met masts used for each reference location were as follows:

Table 12 Lead Met Mast for Each Noise Monitoring Location

Location ID	Lead Met Mast
P22A	M6
Q15A (not monitored in second round)	M1
T25A (not monitored in second round)	M4
V16A	M1

The alternative masts and directional correlation ratios used to avoid wake affects in each wind direction and relate the data back to the lead mast position were as follows:

For lead met mast M1:

Table 13 Meteorological Masts Used for Wind Speed Data

Wind Direction as Measured at Met Mast M1	Met Mast Used for Wind Speed Data
Greater than or equal to 70 degrees and less than 218 degrees	Met Mast M4
Greater than or equal to 218 degrees or less than 20 degrees	Met Mast M1
Greater than or equal to 20 degrees and less than 70 degrees	Met Mast M6

Table 14 Wind Speed Correction Factors M4 to M1

Wind Direction as Measured at Met Mast M1	Correction Factor applied to M4 Wind Speeds
Greater than or equal to 70 degrees and less than 75 degrees	0.988592
Greater than or equal to 75 degrees and less than 105 degrees	1.097402
Greater than or equal to 105 degrees and less than 135 degrees	1.076224
Greater than or equal to 135 degrees and less than 165 degrees	1.061829
Greater than or equal to 165 degrees and less than 195 degrees	1.068266
Greater than or equal to 195 degrees and less than 218 degrees	1.000269

Table 15 Wind Speed Correction Factors M6 to M1

Wind Direction as Measured at Met Mast M1	Correction Factor applied to M4 Wind Speeds
Greater than or equal to 20 degrees and less than 45 degrees	1.056619
Greater than or equal to 45 degrees and less than 70 degrees	1.020335

For lead met mast M4:**Table 16 Meteorological Masts Used for Wind Speed Data**

Wind Direction as Measured at Met Mast M4	Met Mast Used for Wind Speed Data
Greater than or equal to 70 degrees and less than 218 degrees	Met Mast M4
Greater than or equal to 218 degrees and less than 340 degrees	Met Mast M3
Greater than or equal to 340 degrees or less than 70 degrees	Met Mast M6

Table 17 Wind Speed Correction Factors M4 to M3

Wind Direction as Measured at Met Mast M4	Correction Factor applied to M3 Wind Speeds
Greater than or equal to 218 degrees and less than 225 degrees	1.056454
Greater than or equal to 225 degrees and less than 255 degrees	1.023231
Greater than or equal to 255 degrees and less than 285 degrees	1.054981
Greater than or equal to 285 degrees and less than 315 degrees	1.085166
Greater than or equal to 315 degrees and less than 340 degrees	0.993236

Table 18 Wind Speed Correction Factors M6 to M4

Wind Direction as Measured at Met Mast M4	Correction Factor applied to M6 Wind Speeds
Greater than or equal to 340 degrees and less than 345 degrees	1.015667
Greater than or equal to 345 degrees or less than 15 degrees	1.064022
Greater than or equal to 15 degrees and less than 45 degrees	0.983088
Greater than or equal to 45 degrees and less than 70 degrees	0.999326

For lead met mast M6:**Table 19 Meteorological Masts Used for Wind Speed Data**

Wind Direction as Measured at Met Mast M6	Met Mast Used for Wind Speed Data
Greater than or equal to 70 degrees and less than 175 degrees	Met Mast M4
Greater than or equal to 175 degrees or less than 70 degrees	Met Mast M6

Table 20 Wind Speed Correction Factors M4 to M6

Wind Direction as Measured at Met Mast M6	Correction Factor applied to M4 Wind Speeds
Greater than or equal to 70 degrees and less than 75 degrees	1.000303
Greater than or equal to 75 degrees and less than 105 degrees	1.00651
Greater than or equal to 105 degrees and less than 135 degrees	0.97507
Greater than or equal to 135 degrees and less than 165 degrees	1.028481
Greater than or equal to 165 degrees and less than 175 degrees	0.987351

Method for Determining the Anemometer to be Used

On each met mast there are two cup anemometers at 84m above ground level (hub-height). These anemometers are referred to as Cup 1A and Cup 1B.

The two cup anemometers on each met mast are located 180 degrees apart with respect to the met mast tower, and as such, at any given time one of the anemometers will be in the wake of the met mast and the other will be free from the wake of the met mast. The wind speed was therefore taken from whichever of the two cup anemometers was not in the wake of the met mast at each point in time.

Based on met mast information provided by Vestas, the following table shows the wind directions at each met mast for which each cup anemometer is not in the wake of the met mast:

Table 21 Cup Selection Table

Meteorological Mast ID	Wind Directions (WD) not Waked by Met Mast, degrees	
	Cup 1A	Cup 1B
M1	$0 \leq \text{WD} < 45$ and $225 \leq \text{WD} < 360$	$45 \leq \text{WD} < 225$
M2	$0 \leq \text{WD} < 60$ and $240 \leq \text{WD} < 360$	$60 \leq \text{WD} < 240$
M3	$0 \leq \text{WD} < 60$ and $240 \leq \text{WD} < 360$	$60 \leq \text{WD} < 240$
M4	$60 \leq \text{WD} < 240$	$0 \leq \text{WD} < 60$ and $240 \leq \text{WD} < 360$
M5	$60 \leq \text{WD} < 240$	$0 \leq \text{WD} < 60$ and $240 \leq \text{WD} < 360$
M6	$0 \leq \text{WD} < 30$ and $210 \leq \text{WD} < 360$	$30 \leq \text{WD} < 210$

Appendix H

Summary of Data Points Used for Analysis

Appendix H Summary of Data Points Used for Analysis

The following tables present a summary of the data points used in, and excluded from, the analysis of the measured noise levels:

Table 22 Number of All-Time Data Points

Location ID	1 - Available Noise Data Points	2 - Data Points excluded due to Non-Operational Wind Turbines	3 - Additional Data Points excluded due to Rain	4 - Additional Data Points excluded due to Extraneous Noise	5 - Total Data Points used for All-Time Analysis
P22A	4032	1523	28	19	2462
V16A	4020	736	57	0	3227

Table 23 Number of Night-Time Data Points

Location ID	5 - Total Data Points used for All-Time Analysis	6 - Day-time Data Points Excluded	7 - Total Data Points used for Night-Time Analysis
P22A	2462	1481	981
V16A	3227	1966	1261